

BAR CASE# **BAR2025-00391**

(OFFICE USE ONLY)

ADDRESS OF PROJECT: _____

DISTRICT: ☐ Old & Historic Alexandria ☐ Parker – Gray ☐ 100 Year Old Building

TAX MAP AND PARCEL: _____ ZONING: _____

APPLICATION FOR: *(Please check all that apply)*

☐ CERTIFICATE OF APPROPRIATENESS

☐ PERMIT TO MOVE, REMOVE, ENCAPSULATE OR DEMOLISH
(Required if more than 25 square feet of a structure is to be demolished/impacted)

☐ WAIVER OF VISION CLEARANCE REQUIREMENT and/or YARD REQUIREMENTS IN A VISION
CLEARANCE AREA (Section 7-802, Alexandria 1992 Zoning Ordinance)

☐ WAIVER OF ROOFTOP HVAC SCREENING REQUIREMENT
(Section 6-403(B)(3), Alexandria 1992 Zoning Ordinance)

Applicant: ☐ Property Owner ☐ Business *(Please provide business name & contact person)*

Name: _____

Address: _____

City: _____

State: _____ Zip: _____

Phone: _____

E-mail: _____

Authorized Agent *(if applicable)*: ☐ Attorney ☐ Architect ☐ _____

Name: _____

Phone: _____

E-mail: _____

Legal Property Owner:

Name: _____

Address: _____

City: _____

State: _____ Zip: _____

Phone: _____

E-mail: _____

NATURE OF PROPOSED WORK: *Please check all that apply*

- ☐ NEW CONSTRUCTION
- ☐ EXTERIOR ALTERATION: *Please check all that apply.*
- | | | | |
|--------------------------------------|---|---|-----------------------------------|
| <input type="checkbox"/> awning | <input type="checkbox"/> fence, gate or garden wall | <input type="checkbox"/> HVAC equipment | <input type="checkbox"/> shutters |
| <input type="checkbox"/> doors | <input type="checkbox"/> windows | <input type="checkbox"/> siding | <input type="checkbox"/> shed |
| <input type="checkbox"/> lighting | <input type="checkbox"/> pergola/trellis | <input type="checkbox"/> painting unpainted masonry | |
| <input type="checkbox"/> other _____ | | | |
- ☐ ADDITION
- ☐ DEMOLITION/ENCAPSULATION
- ☐ SIGNAGE

DESCRIPTION OF PROPOSED WORK: *Please describe the proposed work in detail (Additional pages may be attached).*

SUBMITTAL REQUIREMENTS:

- ☐ Check this box if there is a homeowner's association for this property. If so, you must attach a copy of the letter approving the project.

Items listed below comprise the **minimum supporting materials** for BAR applications. Staff may request additional information during application review. Please refer to the relevant section of the *Design Guidelines* for further information on appropriate treatments.

Applicants must use the checklist below to ensure the application is complete. Include all information and material that are necessary to thoroughly describe the project. Incomplete applications will delay the docketing of the application for review. Pre-application meetings are required for all proposed additions. All applicants are encouraged to meet with staff prior to submission of a completed application.

Demolition/Encapsulation : *All applicants requesting 25 square feet or more of demolition/encapsulation must complete this section. Check N/A if an item in this section does not apply to your project.*

- N/A
- ☐ ☐ Survey plat showing the extent of the proposed demolition/encapsulation.
- ☐ ☐ Existing elevation drawings clearly showing all elements proposed for demolition/encapsulation.
- ☐ ☐ Clear and labeled photographs of all elevations of the building if the entire structure is proposed to be demolished.
- ☐ ☐ Description of the reason for demolition/encapsulation.
- ☐ ☐ Description of the alternatives to demolition/encapsulation and why such alternatives are not considered feasible.

Additions & New Construction: Drawings must be to scale and should not exceed 11" x 17" unless approved by staff. Check N/A if an item in this section does not apply to your project.

- ☐ ☐ ^{N/A} Scaled survey plat showing dimensions of lot and location of existing building and other structures on the lot, location of proposed structure or addition, dimensions of existing structure(s), proposed addition or new construction, and all exterior, ground and roof mounted equipment.
- ☐ ☐ FAR & Open Space calculation form.
- ☐ ☐ Clear and labeled photographs of the site, surrounding properties and existing structures, if applicable.
- ☐ ☐ Existing elevations must be scaled and include dimensions.
- ☐ ☐ Proposed elevations must be scaled and include dimensions. Include the relationship to adjacent structures in plan and elevations.
- ☐ ☐ Materials and colors to be used must be specified and delineated on the drawings. Actual samples may be provided or required.
- ☐ ☐ Manufacturer's specifications for materials to include, but not limited to: roofing, siding, windows, doors, lighting, fencing, HVAC equipment and walls.
- ☐ ☐ For development site plan projects, a model showing mass relationships to adjacent properties and structures.

Signs & Awnings: One sign per building under one square foot does not require BAR approval unless illuminated. All other signs including window signs require BAR approval. Check N/A if an item in this section does not apply to your project.

- ☐ ☐ ^{N/A} Linear feet of building: Front: _____ Secondary front (if corner lot): _____.
- ☐ ☐ Square feet of existing signs to remain: _____.
- ☐ ☐ Photograph of building showing existing conditions.
- ☐ ☐ Dimensioned drawings of proposed sign identifying materials, color, lettering style and text.
- ☐ ☐ Location of sign (show exact location on building including the height above sidewalk).
- ☐ ☐ Means of attachment (drawing or manufacturer's cut sheet of bracket if applicable).
- ☐ ☐ Description of lighting (if applicable). Include manufacturer's cut sheet for any new lighting fixtures and information detailing how it will be attached to the building's facade.

Alterations: Check N/A if an item in this section does not apply to your project.

- ☐ ☐ ^{N/A} Clear and labeled photographs of the site, especially the area being impacted by the alterations, all sides of the building and any pertinent details.
- ☐ ☐ Manufacturer's specifications for materials to include, but not limited to: roofing, siding, windows, doors, lighting, fencing, HVAC equipment and walls.
- ☐ ☐ Drawings accurately representing the changes to the proposed structure, including materials and overall dimensions. Drawings must be to scale.
- ☐ ☐ An official survey plat showing the proposed locations of HVAC units, fences, and sheds.
- ☐ ☐ Historic elevations or photographs should accompany any request to return a structure to an earlier appearance.

ALL APPLICATIONS: *Please read and check that you have read and understand the following items:*

- ☐ I understand that after reviewing the proposed alterations, BAR staff will invoice the appropriate filing fee in APEX. The application will not be processed until the fee is paid online.
- ☐ I understand the notice requirements and will return a copy of the three respective notice forms to BAR staff at least five days prior to the hearing. If I am unsure to whom I should send notice I will contact Planning and Zoning staff for assistance in identifying adjacent parcels.
- ☐ I, the applicant, or an authorized representative will be present at the public hearing.
- ☐ I understand that any revisions to this initial application submission (including applications deferred for restudy) must be accompanied by the BAR Supplemental form and revised materials.

The undersigned hereby attests that all of the information herein provided including the site plan, building elevations, prospective drawings of the project, and written descriptive information are true, correct and accurate. The undersigned further understands that, should such information be found incorrect, any action taken by the Board based on such information may be invalidated. The undersigned also hereby grants the City of Alexandria permission to post placard notice as required by Article XI, Division A, Section 11-301(B) of the 1992 Alexandria City Zoning Ordinance, on the property which is the subject of this application. The undersigned also hereby authorizes the City staff and members of the BAR to inspect this site as necessary in the course of research and evaluating the application. The applicant, if other than the property owner, also attests that he/she has obtained permission from the property owner to make this application.

APPLICANT OR AUTHORIZED AGENT:

Signature: _____

Printed Name: _____

Date: _____

AMERICAN MICROGRID
SOLUTIONS

Illumine-i Ver. 2.1: 06/05/2024

<div>GENERAL NOTES: NEC 2020</div> <div><div><div>1. EXISTING PLUMBING VENTS, SKYLIGHTS, EXHAUST OUTLETS, VENTILATION INTAKE AIR OPENINGS SHALL NOT BE COVERED BY THE SOLAR PHOTOVOLTAIC SYSTEM.</div><div>2. INVERTERS, MOTOR GENERATORS, PV MODULES, AC MODULES AND AC MODULE SYSTEMS, DC COMBINERS, DC-TO-DC CONVERTERS, RAPID SHUTDOWN EQUIPMENT, DC CIRCUIT CONTROLLERS, AND CHARGE CONTROLLERS INTENDED FOR USE IN PV SYSTEMS SHALL BE LISTED OR BE EVALUATED FOR THE APPLICATION AND HAVE A FIELD LABEL APPLIED. [NEC 690.4(B)]</div><div>3. ALL OUTDOOR EQUIPMENT SHALL BE NEMA 3R RATED, INCLUDING ALL ROOF MOUNTED TRANSITION BOXES AND SWITCHES.</div><div>4. ALL EQUIPMENT SHALL BE PROPERLY GROUNDED AND BONDED IN ACCORDANCE WITH NEC ARTICLE 250.</div><div>5. PV SYSTEM DC CIRCUIT AND INVERTER OUTPUT CONDUCTORS AND EQUIPMENT SHALL BE PROTECTED AGAINST OVERCURRENT. [NEC 690.9(A)]</div><div>6. ALL PHOTOVOLTAIC (PV) MODULES SHALL BE MOUNTED ON THE ROOF, CARPORT, ETC.</div><div>7. THE UTILITY INTERACTIVE INVERTERS SHALL TRIP OR SHALL BE PERMITTED TO AUTOMATICALLY DISCONNECTED FROM ALL UNGROUNDED CONDUCTORS OF THE PRIMARY SOURCE WHEN ONE OR MORE OF THE PHASES OF THE PRIMARY SOURCE TO WHICH IT IS CONNECTED OPENS. THE INTERACTIVE ELECTRIC POWER PRODUCTION EQUIPMENT SHALL NOT BE RECONNECTED TO THE PRIMARY SOURCE UNTIL ALL THE PHASES OF THE PRIMARY SOURCE TO WHICH IT IS CONNECTED ARE RESTORED. [NEC 705.40]</div><div>8. EQUIPMENT DISCONNECTING MEANS SHALL HAVE RATINGS SUFFICIENT FOR THE MAXIMUM CIRCUIT CURRENT, VOLTAGE, AND AVAILABLE FAULT CURRENT. THE DISCONNECTING MEANS SHALL SIMULTANEOUSLY DISCONNECT ALL CURRENT-CARRYING CONDUCTORS THAT ARE NOT SOLIDLY GROUNDED WHICH IT IS CONNECTED TO AND SHALL BE OPERABLE WITHOUT EXPOSING THE OPERATOR TO ANY ENERGIZED PARTS OF THE DISCONNECT. [NEC 690.15(C)]</div><div>9. ALL CONDUCTORS EXPOSED TO WEATHER SHALL BE LISTED AND IDENTIFIED FOR USE IN DIRECT SUNLIGHT. [NEC 310.10(D)]</div><div>10. THE MODULE CONDUCTORS MUST BE TYPE USE-2 OR LISTED FOR PHOTOVOLTAIC (PV) WIRE. [NEC 690.31(C)(1)]</div><div>11. PV SYSTEM DC CIRCUIT CONDUCTORS SHALL BE IDENTIFIED AT ALL TERMINATIONS, CONNECTIONS, AND SPLICE POINTS BY COLOR CODING, MARKING TAPE, TAGGING, OR OTHER APPROVED MEANS. [NEC 690.31(B)(1)]</div><div>12. ALL GROUNDED CONDUCTORS SHALL BE PROPERLY COLOR IDENTIFIED AS WHITE OR GRAY. [NEC 200.6]</div><div>13. PV SYSTEM CONNECTED ON THE LOAD SIDE OR SOURCE SIDE OF THE SERVICE DISCONNECTING MEANS OF THE OTHER SOURCE(S) AT ANY DISTRIBUTION EQUIPMENT ON THE PREMISES SHALL BE IN ACCORDANCE WITH NEC 705.11 (SUPPLY SIDE) & 705.12 (LOAD SIDE).</div><div>14. EACH SOURCE CONNECTION SHALL BE MADE AT A DEDICATED CIRCUIT BREAKER OR FUSIBLE DISCONNECTING MEANS. [(NEC 705.12(A))</div><div>15. THE SUM OF THE AMPERE RATING OF THE OVERCURRENT DEVICES IN CIRCUITS SUPPLYING POWER TO THE BUSBAR OR CONDUCTOR SHALL NOT EXCEED 120% OF THE RATING OF THE BUSBAR OR CONDUCTOR AND THE INTERCONNECTION POINT SHALL BE LOCATED AT THE OPPOSITE END OF THE BUSBAR AS THE PRIMARY POWER SOURCE. [NEC 705.12(B)(3)(2)]</div><div>16. THE INTERCONNECTION POINT OF PRODUCTION EQUIPMENT SHALL BE CONNECTED TO THE SUPPLY SIDE OF THE GROUND-FAULT PROTECTION EQUIPMENT INSTALLED IN AC CIRCUITS AS REQUIRED ELSEWHERE IN THIS CODE, BUT SHALL BE PERMITTED TO BE MADE TO THE LOAD SIDE OF THE GROUND-FAULT PROTECTED EQUIPMENT PROVIDED THERE IS GROUND-FAULT PROTECTION FOR EQUIPMENT FROM ALL GROUND-FAULT CURRENT SOURCES. [NEC 705.32]</div><div>17. EQUIPMENT CONTAINING OVERCURRENT DEVICES IN CIRCUITS SUPPLYING POWER TO A BUS BAR OR CONDUCTOR SHALL BE MARKED TO INDICATE THE PRESENCE OF ALL SOURCES. [NEC 705.12(C)]</div><div>18. FUSED DISCONNECTS, UNLESS OTHERWISE MARKED, SHALL BE CONSIDERED SUITABLE FOR BACKFEED. CIRCUIT BREAKERS NOT MARKED "LINE" AND "LOAD" SHALL BE CONSIDERED SUITABLE FOR BACKFEED. CIRCUIT BREAKERS MARKED "LINE" AND "LOAD" SHALL BE CONSIDERED SUITABLE FOR BACKFEED OR REVERSE CURRENT IF SPECIFICALLY RATED. [NEC 705.12(D)]</div><div>19. ALL THE NEC REQUIRED WARNING SIGNS, MARKINGS, AND LABELS SHALL BE POSTED ON EQUIPMENT AND DISCONNECTS PRIOR TO ANY INSPECTIONS TO BE PERFORMED BY THE BUILDING DEPARTMENT INSPECTOR.</div><div>20. METAL RACEWAYS, TYPE MC METAL-CLAD CABLE THAT COMPLIES WITH NEC 250.118(10) OR METALLIC ENCLOSURES ARE REQUIRED AS WIRING METHOD FOR INSIDE THE BUILDING FOR PV SYSTEM DC CIRCUITS THAT EXCEED 30 VOLTS OR 8 AMPERES. [NEC 690.31(D)]</div><div>21. FLEXIBLE, FINE-STRANDED CABLES SHALL BE TERMINATED ONLY WITH TERMINALS, LUGS, DEVICES OR CONNECTOR IN ACCORDANCE WITH NEC 110.14. [NEC 690.31(C)(5)]</div><div>22. CONNECTORS SHALL BE OF LATCHED OR LOCKING TYPE. CONNECTORS THAT ARE READILY ACCESSIBLE AND OPERATING AT OVER 30 VOLTS DC OR 15 VOLTS AC SHALL REQUIRE TOOL TO OPEN AND MARKED "DO NOT DISCONNECT UNDER LOAD" OR "NOT FOR CURRENT INTERRUPTING". [NEC 690.33(C) & (D)(2)]</div><div>23. EQUIPMENT GROUNDING CONDUCTOR FOR PV SYSTEMS WITHOUT GROUND FAULT PROTECTION (GFP) AND INSTALLED ON NON-DWELLING UNIT MUST HAVE AMPACITY OF AT LEAST #10 AWG.</div><div>24. GROUNDING ELECTRODE CONDUCTOR WILL BE CONTINUOUS. [NEC 250.64(C)]</div><div>25. EQUIPMENT PROPOSED TO BE MOUNTED ON EXTERIOR WALLS ARE TO MAINTAIN CLEARANCE TO OPERABLE WINDOWS PER MANUFACTURERS RECOMMENDATION AND CODE.</div></div><div>EQUIPMENT:</div><div><div>1. EQUIPMENT COMPONENTS SHALL BE LISTED AND LABELED BY A NATIONALLY-RECOGNIZED TESTING LABORATORY(NRTL), SUCH AS UL OR ETL, WHERE SUCH LISTING IS AVAILABLE FOR THE APPLICATION.</div><div>2. DANGER, WARNING, AND CAUTION LABELS SHALL BE PROVIDED AS REQUIRED BY NESC, OR OSHA STANDARDS ON EQUIPMENT ENCLOSURES, DOORS, ACCESS PLATES, AND BARRIERS. LABEL ALL MEDIUM VOLTAGE EQUIPMENT WITH THE OPERATING VOLTAGE.</div><div>3. ALL OPENINGS INTO EQUIPMENT SHALL BE SEALED WITH GALVANIZED STEEL PLATE OR SCREEN TO PREVENT INSECTS AND RODENTS FROM ENTERING.</div><div>4. ALL CONDUCTORS SHALL BE ROUTED TO MAINTAIN ACCESS TO INDICATORS, VALVES, SAMPLE PORTS, SWITCHES, TAP CHANGES, FUSE WELLS, AND OTHER COMPONENTS AND ACCESSORIES REQUIRING OPERATOR ACCESS.</div><div>5. INSTALL BOLLARDS AS REQUIRED.</div></div><div>ELECTRICAL NOTES FOR NEW PHOTOVOLTAIC SYSTEM:</div><div><div>1. THIS PROPOSED SOLAR ELECTRIC SYSTEM IS INTENDED TO OPERATE IN PARALLEL WITH POWER RECEIVED FROM THE UTILITY SERVICE PROVIDER.</div><div>2. THE INVERTER FOR THE PROPOSED SOLAR ELECTRIC SYSTEM SHALL BE IDENTIFIED FOR USE IN SOLAR PHOTOVOLTAIC SYSTEMS. ALL EQUIPMENT SHALL BE UL APPROVED.</div><div>3. THIS SYSTEM IS INTENDED TO CONNECT TO THE EXISTING FACILITY POWER SYSTEM AT A SINGLE POINT, POINT OF COMMON COUPLING (POCC). THIS CONNECTION SHALL BE IN COMPLIANCE WITH THE NEC.</div><div>4. ALL SOURCE CIRCUITS SHALL HAVE INDIVIDUAL SOURCE CIRCUIT PROTECTION, AS REQUIRED, FOR TESTING AND ISOLATION.</div><div>5. ALL DISCONNECTS AND COMBINERS SHALL BE SECURED FROM UNAUTHORIZED OR UNQUALIFIED PERSONNEL BY LOCK OR LOCATION.</div><div>6. ALL DISCONNECTS, COMBINERS, PULL/SPLICE BOXES, AND ENCLOSURES SHALL BE LISTED FOR ITS PURPOSE.</div><div>7. EQUIPMENT SHALL BE INSTALLED IN A SECURE AREA. INVERTER PERFORMANCE MAY BE AFFECTED IF INSTALLED IN DIRECT SUNLIGHT.</div></div></div>		<div>WIRING AND WIRING METHODS:</div> <div><div>1. THE EXPOSED PV SOLAR MODULE WIRING AND PV SOURCE CIRCUITS TO BE UV RESISTANT, RATED FOR WET CONDITIONS, AND USE 2,000V PV WIRE WITH A TEMPERATURE RATING OF 90°C.</div><div>2. ALL EXPOSED CABLES, SUCH AS MODULE LEADS, SHALL BE SECURED IN A NEAT WORKMANLIKE MANNER TO PREVENT CHAFFING, SWINGING, AND EXCEEDING MINIMUM BEND RADIUS WITH PROPER MECHANICAL SUNLIGHT-RESISTANT MEANS AND ROUTED TO AVOID DIRECT EXPOSURE TO SUNLIGHT AT ALL TIMES.</div><div>3. ALL FIELD WIRING THAT IS NOT COLOR-CODED SHALL BE TAGGED AT BOTH ENDS WITH PERMANENT WIRE MARKERS TO IDENTIFY POLARITY AND GROUND.</div><div>4. FLEXIBLE METAL CONDUIT IS SUITABLE FOR INSTALLATION IN DRY LOCATIONS; SHOULD IT BE EMPLOYED, SUPPORTS WILL BE NO MORE THAN 12 INCHES FROM BOXES (JUNCTION BOX, CABINETS, OR CONDUIT FITTING) AND NO MORE THAN 48 INCHES APART.</div><div>5. LIQUID-TIGHT FLEXIBLE METAL AND NON-METALLIC CONDUIT IS SUITABLE FOR INSTALLATION IN WET AND DRY LOCATIONS. SHOULD IT BE EMPLOYED, SUPPORTS WILL BE NO MORE THAN 12 INCHES FROM BOXES (JUNCTION BOX, CABINETS, OR CONDUIT FITTING) AND NO MORE THAN 36 INCHES APART.</div><div>6. PVC CONDUIT AND FITTINGS SHALL NOT BE USED ON ROOFTOP CONDITIONS OR EXPOSED TO DIRECT SUNLIGHT. WHEN USED IN ACCEPTABLE LOCATION CONDUIT SHALL BE SCHEDULE 80 UV RESISTANT UNLESS NOTED OTHERWISE.</div><div>7. FUSES AND WIRES SUBJECT TO TEMPERATURE CONDITIONS GREATER THAN 100°F OR TRANSFORMER INRUSH CURRENT SHALL BE SIZED ACCORDINGLY.</div><div>8. THE PHOTOVOLTAIC SOURCE CIRCUITS AND PHOTOVOLTAIC OUTPUT CIRCUITS OF THIS PROPOSED SOLAR SYSTEM SHALL NOT BE CONTAINED IN THE SAME RACEWAY CABLE TRAY, CABLE, OUTLET BOX, OR SIMILAR FITTING AS FEEDERS OR BRANCH CIRCUITS OF OTHER SYSTEMS UNLESS THE CONDUCTORS OF THE DIFFERENT SYSTEMS ARE SEPARATED BY A PARTITION OR ARE CONNECTED TOGETHER.</div><div>9. ALL TERMINATIONS SHALL HAVE ANTI-OXIDANT COMPOUND AND BE TORQUED PER DEVICE LISTED OR MANUFACTURER'S RECOMMENDATION.</div><div>10. SPLIT BOLTS/SPLICED/CONNECTORS ARE PERMITTED ON THE AC CONDUCTORS AND SHALL BE INSULATED WITH APPROVED MEANS. SPLICES ON DC CONDUCTORS ARE PERMITTED WITH THE APPROPRIATE CONDUCTORS PER THE NEC CODE.</div><div>11. NO PVC CONDUIT ALLOWED ON ROOF, UNLESS OPEN-ENDED WIRE MANAGEMENT < 10'.</div></div> <div>GROUNDING:</div> <div><div>1. EQUIPMENT GROUNDING CONDUCTORS MAY BE COPPER OR ALUMINUM.</div><div>2. PARTS OF THE ELECTRICAL INSTALLATION TO BE GROUNDED AND BONDED SHALL INCLUDE, BUT NOT BE LIMITED TO, ELECTRICAL EQUIPMENT, RACEWAYS, BOXES, CABINETS, AND OTHER NON-CURRENT CARRYING METAL PARTS OF THE WIRING SYSTEM, METAL CONDUIT, SWITCHGEAR, HOUSING AND NEUTRALS OF TRANSFORMERS, LIGHTING FIXTURES, AND PANEL DEVICES AS APPLICABLE TO EQUIPMENT INSTALLED ON THIS PROJECT.</div><div>3. RACKING COMPONENTS AND STRUCTURAL SUPPORTS MUST BE ELECTRICALLY BONDED TOGETHER BY AN ACCEPTABLE MEANS.</div><div>4. MODULES SHALL BE GROUNDED PER MODULE AND RACKING MANUFACTURER'S INSTALLATION GUIDELINES. BARE COPPER USED FOR GROUNDING SHALL NOT TOUCH THE ALUMINUM OF THE MODULE FRAMES.</div><div>5. AN EQUIPMENT GROUNDING CONDUCTOR BETWEEN A PV ARRAY AND OTHER EQUIPMENT SHALL BE REQUIRED IN ACCORDANCE WITH NEC ARTICLE 250.</div></div> <div>DISCONNECTING MEANS:</div> <div><div>1. MEANS SHALL BE PROVIDED TO DISCONNECT ALL CURRENT CARRYING CONDUCTORS OF THE PHOTOVOLTAIC POWER SOURCE FROM ALL OTHER CONDUCTORS IN THE BUILDING.</div><div>2. THE GROUNDED CONDUCTOR MAY HAVE A BOLTED OR TERMINAL DISCONNECTING MEANS TO ALLOW MAINTENANCE OR TROUBLESHOOTING BY QUALIFIED PERSONNEL.</div><div>3. EQUIPMENT SUCH AS PHOTOVOLTAIC SOURCE CIRCUITS, OVERCURRENT DEVICES, AND BLOCKING DIODES SHALL BE PERMITTED ON THE PHOTOVOLTAIC SIDE OF THE PHOTOVOLTAIC DISCONNECTING MEANS.</div><div>4. MEANS SHALL BE PROVIDED TO DISCONNECT EQUIPMENT SUCH AS INVERTERS, BATTERIES, CHARGE CONTROLLERS, AND THE LIKE FROM ALL UNGROUNDED CONDUCTORS OF ALL SOURCES. IF THE EQUIPMENT IS ENERGIZED FROM MORE THAN ONE SOURCE, THE DISCONNECTING MEANS SHALL BE GROUPED AND IDENTIFIED.</div><div>5. FUSES AND DISCONNECTING MEANS SHALL BE PROVIDED TO DISCONNECT A FUSE FROM ALL SOURCES OF SUPPLY IF THE FUSE IS ENERGIZED FROM BOTH DIRECTIONS AND IS ACCESSIBLE TO OTHER THAN QUALIFIED PERSONS. SUCH A FUSE IN A PHOTOVOLTAIC SOURCE CIRCUIT SHALL BE CAPABLE OF BEING DISCONNECTED INDEPENDENTLY OF FUSES IN OTHER PHOTOVOLTAIC SOURCE CIRCUITS.</div></div> <div>CONTRACTOR PROCEDURAL NOTES:</div> <div><div>1. THE CONTRACTOR IS RESPONSIBLE FOR THOROUGHLY INSPECTING THE SITE AND BECOMING FAMILIAR WITH ALL ASPECTS OF EXISTING CONDITIONS PRIOR TO COMMENCING CONSTRUCTION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONFIRM THAT THE DRAWINGS AND SPECIFICATIONS ACCURATELY DEPICT AND ACCOUNT FOR THE EXISTING CONDITIONS. ANY LACK OF DETAIL REGARDING EXISTING CONDITIONS IN THE DRAWINGS OR SPECIFICATIONS DOES NOT RELIEVE THE CONTRACTOR FROM PROVIDING ANY MATERIALS OR PERFORMING ANY WORK REQUIRED BY THE DESIGN DOCUMENTATION.</div><div>2. THE CONTRACTOR SHALL PROCURE ALL NECESSARY PERMITS PRIOR TO STARTING CONSTRUCTION.</div><div>3. ANY DEFICIENCIES, ERRORS, INCONSISTENCIES, OR CONFLICTS BETWEEN OBSERVED FIELD CONDITIONS AND THOSE DEPICTED IN THE DESIGN DRAWINGS SHOULD BE NOTED. CONTRACTOR SHALL CONFIRM ALL DIMENSIONS WITH FIELD MEASUREMENTS PRIOR TO STARTING WORK AND REPORT ANY DISCREPANCIES TO ENGINEER OF RECORD.</div><div>4. THE CONTRACTOR SHALL REVIEW ALL CIVIL, ARCHITECTURAL, AND MECHANICAL DRAWINGS AND COORDINATE THE ELECTRICAL WORK WITH THE OTHER TRADES. IF CONFLICTS, DISCREPANCIES, OR DEFICIENCIES ARE FOUND WHICH REQUIRE REVISIONS TO THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER OF RECORD. BEFORE PROCEEDING WITH THE INSTALLATION, CONTRACTOR MUST OBTAIN WRITTEN DIRECTION ON ANY REQUIRED MODIFICATIONS TO THE DESIGN.</div><div>5. ALL EQUIPMENT SHALL BE INSTALLED AS PER THE MANUFACTURER'S INSTRUCTIONS OR PER THE ENGINEER'S CONSTRUCTION DESIGN DOCUMENTS. THE CONTRACTOR SHALL REVIEW AND UNDERSTAND ALL ENGINEERING DRAWINGS AND COMPONENT MANUALS PRIOR TO THE INSTALLATION OR ENERGIZING OF ANY EQUIPMENT. CONTRACTOR IS RESPONSIBLE FOR UNDERSTANDING AND OPERATING ALL INVERTERS IN ACCORDANCE WITH THE LATEST MANUFACTURER'S INSTALLATION AND OPERATION DOCUMENTATIONS, INCLUDING ALL MANUFACTURER'S TECHNICAL BULLETINS AND UPDATES.</div><div>6. THE CONTRACTOR SHALL INSTALL SYSTEM INTERCONNECTION AS REQUIRED BY UTILITY INTERCONNECTION STANDARDS.</div><div>7. ANY CHANGES TO OR DEVIATIONS FROM THE DESIGN MADE PRIOR TO THE RECEIPT OF WRITTEN APPROVAL BY THE ENGINEER OF RECORD ARE DONE AT THE CONTRACTOR'S SOLE RISK. THE CONTRACTOR SHALL SUBMIT WRITTEN REQUESTS FOR INFORMATION (RFI) FOR ANY DISCREPANCIES OR PROPOSED CHANGES. RFIS WILL INCLUDE DETAILED SUBMITTALS FOR REVIEW AND APPROVAL BY THE ENGINEER OF RECORD.</div><div>8. IT IS THE CONTRACTOR'S RESPONSIBILITY TO RECEIVE, STORE, AND SECURE ALL EQUIPMENT PRIOR TO AND DURING INSTALLATION.</div></div>	<div>ELECTRICAL ABBREVIATION:</div> <div><div>ACPACCUMULATION PANEL</div><div>A, AMPAMPERE</div><div>AFAMP FRAME</div><div>AICAMPERE INTERRUPTING CAPACITY</div><div>APPROXAPPROXIMATE(LY)</div><div>ALALUMINUM</div><div>AWGAMERICAN WIRE GAUGE</div><div>BLDGBUILDING</div><div>CB CIRCUIT BREAKER</div><div>CONC CONCRETE</div><div>Cu COPPER</div><div>CT CURRENT TRANSFORMER</div><div>DIA DIAMETER</div><div>DISC DISCONNECT</div><div>(E) EXISTING</div><div>EC ELECTRICAL CONTRACTOR</div><div>EMT ELECTRICAL METALLIC TUBING</div><div>EM EMERGENCY</div><div>ENC ENCLOSURE, ENCLOSED</div><div>EV ELECTRIC VEHICLE</div><div>EVCS ELECTRIC VEHICLE CHARGING STATION</div><div>FMC FLEXIBLE METAL CONDUIT</div><div>G, GND GROUND OR GROUNDING</div><div>GA GALVANIZED</div><div>GFCI GROUND FAULT CIRCUIT INTERRUPTER</div><div>IN INCHES</div><div>J, JB JUNCTION BOX</div><div>KCMIL THOUSAND CIRCULAR MILS</div><div>KV KILOVOLT</div><div>KVA KILOVOLT - AMPERE</div><div>KWp KILOWATT PEAK</div><div>MAX MAXIMUM</div><div>MCB MAIN CIRCUIT BREAKER</div><div>MDP MAIN DISTRIBUTION PANEL</div><div>MSP MAIN SERVICE PANEL</div><div>MFR MANUFACTURER</div><div>MH MANHOLE</div><div>MIN MINIMUM</div><div>MLO MAIN LUGS ONLY</div><div>N, NEUT NEUTRAL</div><div>(N) NEW</div><div>NEC NATIONAL ELECTRICAL CODE</div><div>NEMA NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION</div><div>NTS NOT TO SCALE</div><div>OCPD OVERCURRENT PROTECTIVE DEVICE</div><div>OH OVERHEAD</div><div>P POLE</div><div>PT POTENTIAL TRANSFORMER</div><div>PV PHOTOVOLTAIC</div><div>PVC POLYVINYL CHLORIDE</div><div>RMC RIGID METAL CONDUIT</div><div>SCH SCHEDULE</div><div>SP SPARE</div><div>TX, XFMR TRANSFORMER</div><div>TB TERMINAL BLOCK</div><div>TBD TO BE DETERMINED</div><div>TYP TYPICAL</div><div>UG UNDERGROUND</div><div>UON UNLESS OTHERWISE NOTED</div></div> <div>LEGEND:</div> <div><div><div></div><div>MODULES</div><div></div><div>DRIVE WAY</div><div></div><div>WHEEL STOPS</div></div><div><div></div><div>EQUIPMENT</div><div></div><div>SETBACK</div><div></div><div>PROPERTY LINE</div></div><div><div></div><div>OBSTRUCTION</div><div></div><div>AC CONDUIT RUN (ABOVE GROUND)</div><div></div><div>PEDESTAL</div></div><div><div></div><div>INVERTER</div><div></div><div>AC CONDUIT RUN (UNDERGROUND)</div><div></div><div>EV CHARGER</div></div><div><div></div><div>TRANSFORMER</div><div></div><div>DC CONDUIT RUN (ABOVE GROUND)</div><div></div><div>FUSED DISCONNECT</div></div><div><div></div><div>METER</div><div></div><div>DC CONDUIT RUN (UNDERGROUND)</div><div></div><div>SIGNAGE (LOCATION)</div></div><div><div></div><div>NON-FUSED DISCONNECT</div><div></div><div>CIRCUIT BREAKER</div><div></div><div>SAFETY BOLLARD</div></div></div>
<div>AMERICAN MICROGRID SOLUTIONS</div>			
SYSTEM INFORMATION			
SYSTEM SIZE (DC/AC): 101.20 kWp DC / 100.00 kW AC			
MODULES: (253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)			
INVERTERS: (2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)			
OPTIMIZER/MLPE: (129)SOLAREEDGE P1101 POWER OPTIMIZER			
WIND SPEED: 130MPH SNOW LOAD: 61PSF EXPOSURE CAT.: B			
AHJ:VA-CITY OF ALEXANDRIA			
UTILITY:DOMINION ENERGY			
MIN. TEMP.: -11°C		MAX. TEMP.: 35.1°C	
SOLAR PV PROJECT:			
DURANT RECREATION CENTER 1605 CAMERON ST, ALEXANDRIA, VA 22314 38.807904, -77.056381 APN #10294550 PROJECT #AMG-DG-2024-499			
REVISION HISTORY			
REV	DATE	DESCRIPTION	
A	03/24/2025	PERMIT PLAN	
B	06/17/2025	SYSTEM SIZE UPDATE	
ILLUMINE i			
ILLUMINE INTERNATIONAL INC. 1320 ARROW POINT DR, STE 501, #163 CEDAR PARK, TX 78613			
THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.			
GENERAL NOTES			
DESIGNED BY/CHECKED BY: ARUN S/RAM BALAJI			
PAPER SIZE: 24" X 36"			
SCALE: AS NOTED		REV:B	
DATE: 06/17/2025		G-02	

SITE PLAN:



SCALE:1"=40'-0"



AMERICAN MICROGRID
SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC): 101.20 kWp DC / 100.00 kW AC	
MODULES: (253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)	
INVERTERS: (2)SOLAREDGE TECHNOLOGIES SE50KUS (208V, 3PH)	
OPTIMIZER/MLPE: (129)SOLAREDGE P1101 POWER OPTIMIZER	
WIND SPEED: 130MPH SNOW LOAD: 61PSF EXPOSURE CAT.: B	
AHJ:VA-CITY OF ALEXANDRIA	
UTILITY:DOMINION ENERGY	
MIN. TEMP.: -11°C	MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

DURANT RECREATION
CENTER
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

SITE PLAN

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED

DATE: 06/17/2025


REV:B

E-01

ENLARGED SITE PLAN:

ARRAY	QUANTITY	MODULE/ROOF TILT	AZIMUTH
ARRAY-01	80	27°	279°
ARRAY-02	76	27°	99°
ARRAY-03	36	10°	189°
ARRAY-04	29	10°	189°
ARRAY-05	32	10°	189°
TOTAL MODULES	253		

NOTE:
ADD PULL BOXES IN PLACES WHERE THE CONDUIT RUN
BENDS MORE THAN 360 DEGREES.

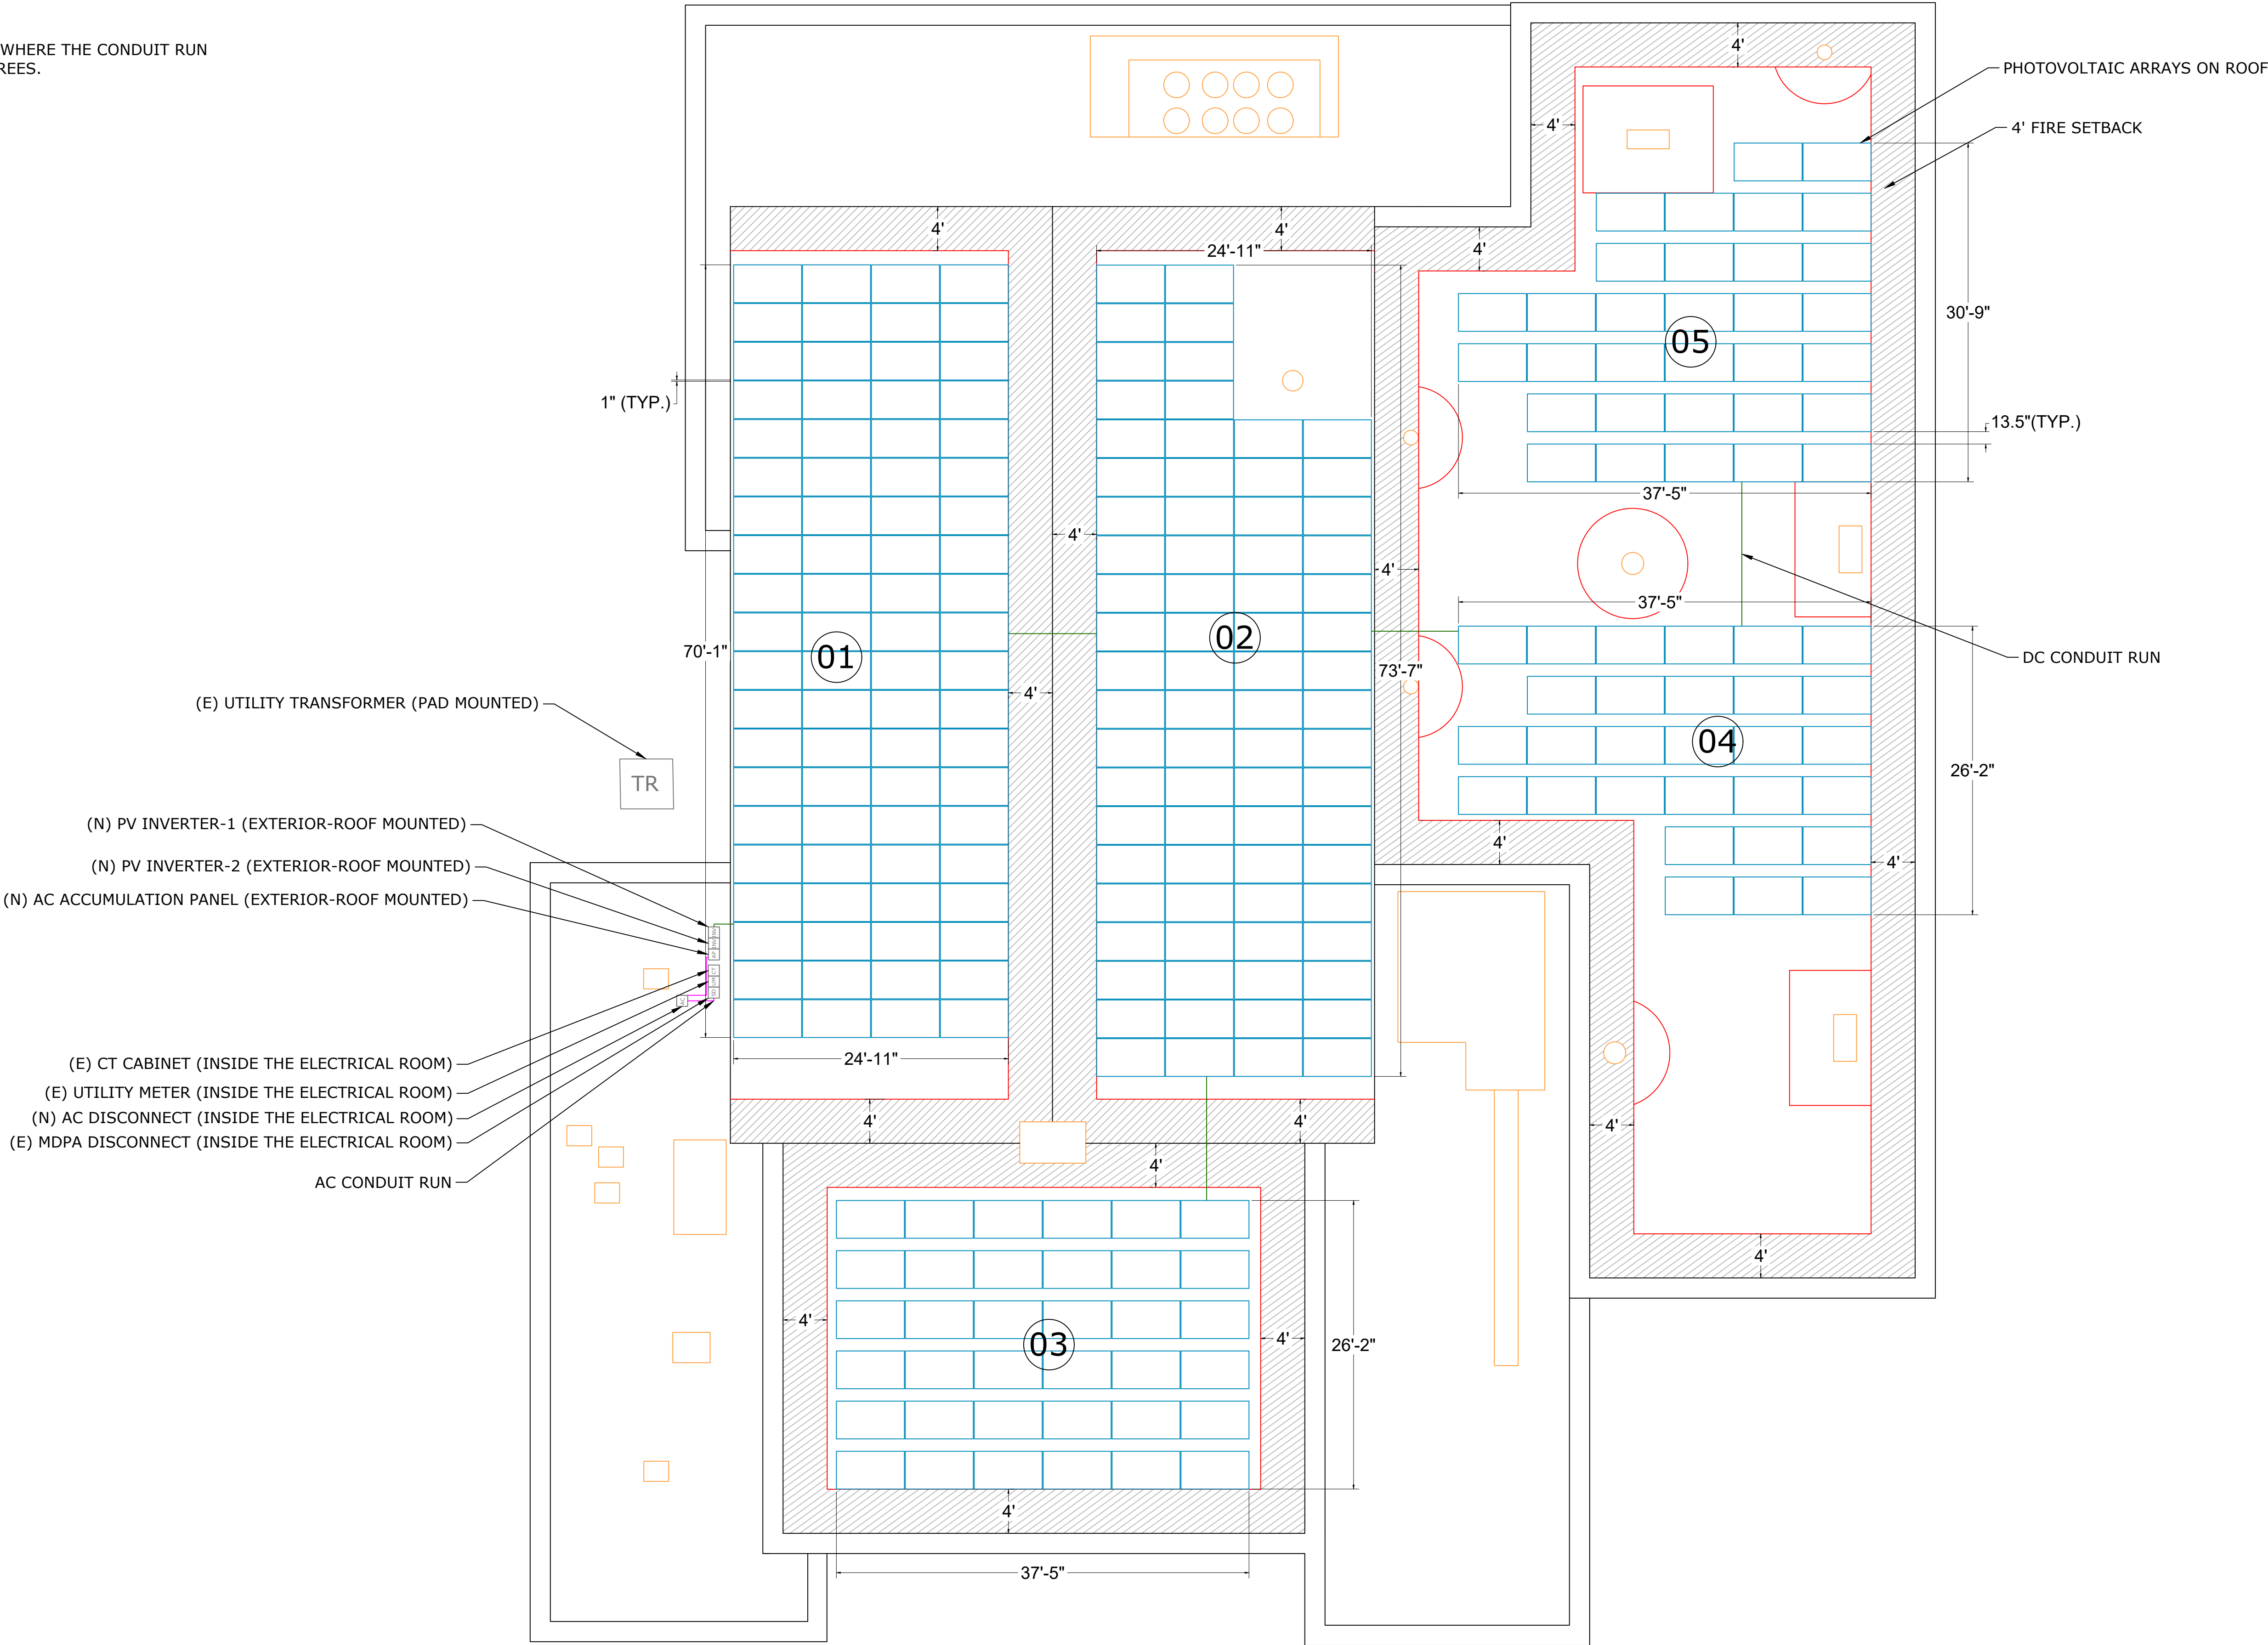

SCALE:1/8" = 1'-0"



SYSTEM INFORMATION

SYSTEM SIZE (DC/AC): 101.20 kWp DC / 100.00 kW AC	
MODULES: (253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)	
INVERTERS: (2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)	
OPTIMIZER/MLPE: (129)SOLAREEDGE P1101 POWER OPTIMIZER	
WIND SPEED: 130MPH SNOW LOAD: 61PSF EXPOSURE CAT.: B	
AHJ: VA-CITY OF ALEXANDRIA	
UTILITY: DOMINION ENERGY	
MIN. TEMP.: -11°C	MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

**DURANT RECREATION
CENTER**
**1605 CAMERON ST,
ALEXANDRIA, VA 22314**
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE
INTERNATIONAL INC. THE INFORMATION CONTAINED IN
THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS
WITHOUT THE WRITTEN CONSENT OF ILLUMINE
INTERNATIONAL INC.


ENLARGED SITE PLAN

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED	REV:B
DATE: 06/17/2025	E-01.1


ELECTRICAL STRING PLAN:

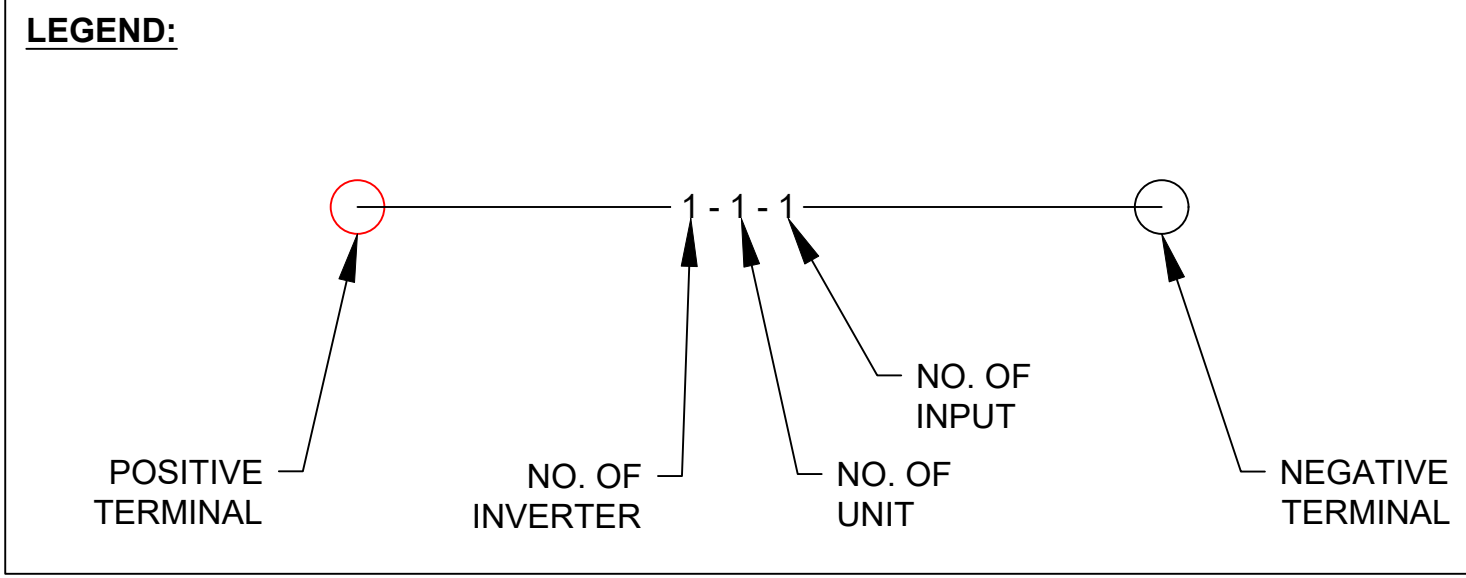

STRINGING DETAILS					
INVERTER-01			INVERTER-02		
STRING	MOD. QTY.	OPT. QTY.	STRING	MOD. QTY.	OPT. QTY.
1-1-1	22	11	2-1-1	21	11
1-1-2	22	11	2-1-2	20	10
1-2-1	22	11	2-2-1	21	11
1-2-2	22	11	2-2-2	20	10
1-3-1	21	11	2-3-1	21	11
1-3-2	21	11	2-3-2	20	10
TOTAL	130	66	TOTAL	123	63

NOTE:
ADD PULL BOXES IN PLACES WHERE THE CONDUIT RUN
BENDS MORE THAN 360 DEGREES.

- (E) UTILITY TRANSFORMER (PAD MOUNTED)
- (N) PV INVERTER-1 (EXTERIOR-ROOF MOUNTED)
- (N) PV INVERTER-2 (EXTERIOR-ROOF MOUNTED)
- (N) AC ACCUMULATION PANEL (EXTERIOR-ROOF MOUNTED)
- (E) CT CABINET (INSIDE THE ELECTRICAL ROOM)
- (E) UTILITY METER (INSIDE THE ELECTRICAL ROOM)
- (N) AC DISCONNECT (INSIDE THE ELECTRICAL ROOM)
- (E) MDPA DISCONNECT (INSIDE THE ELECTRICAL ROOM)
- AC CONDUIT RUN

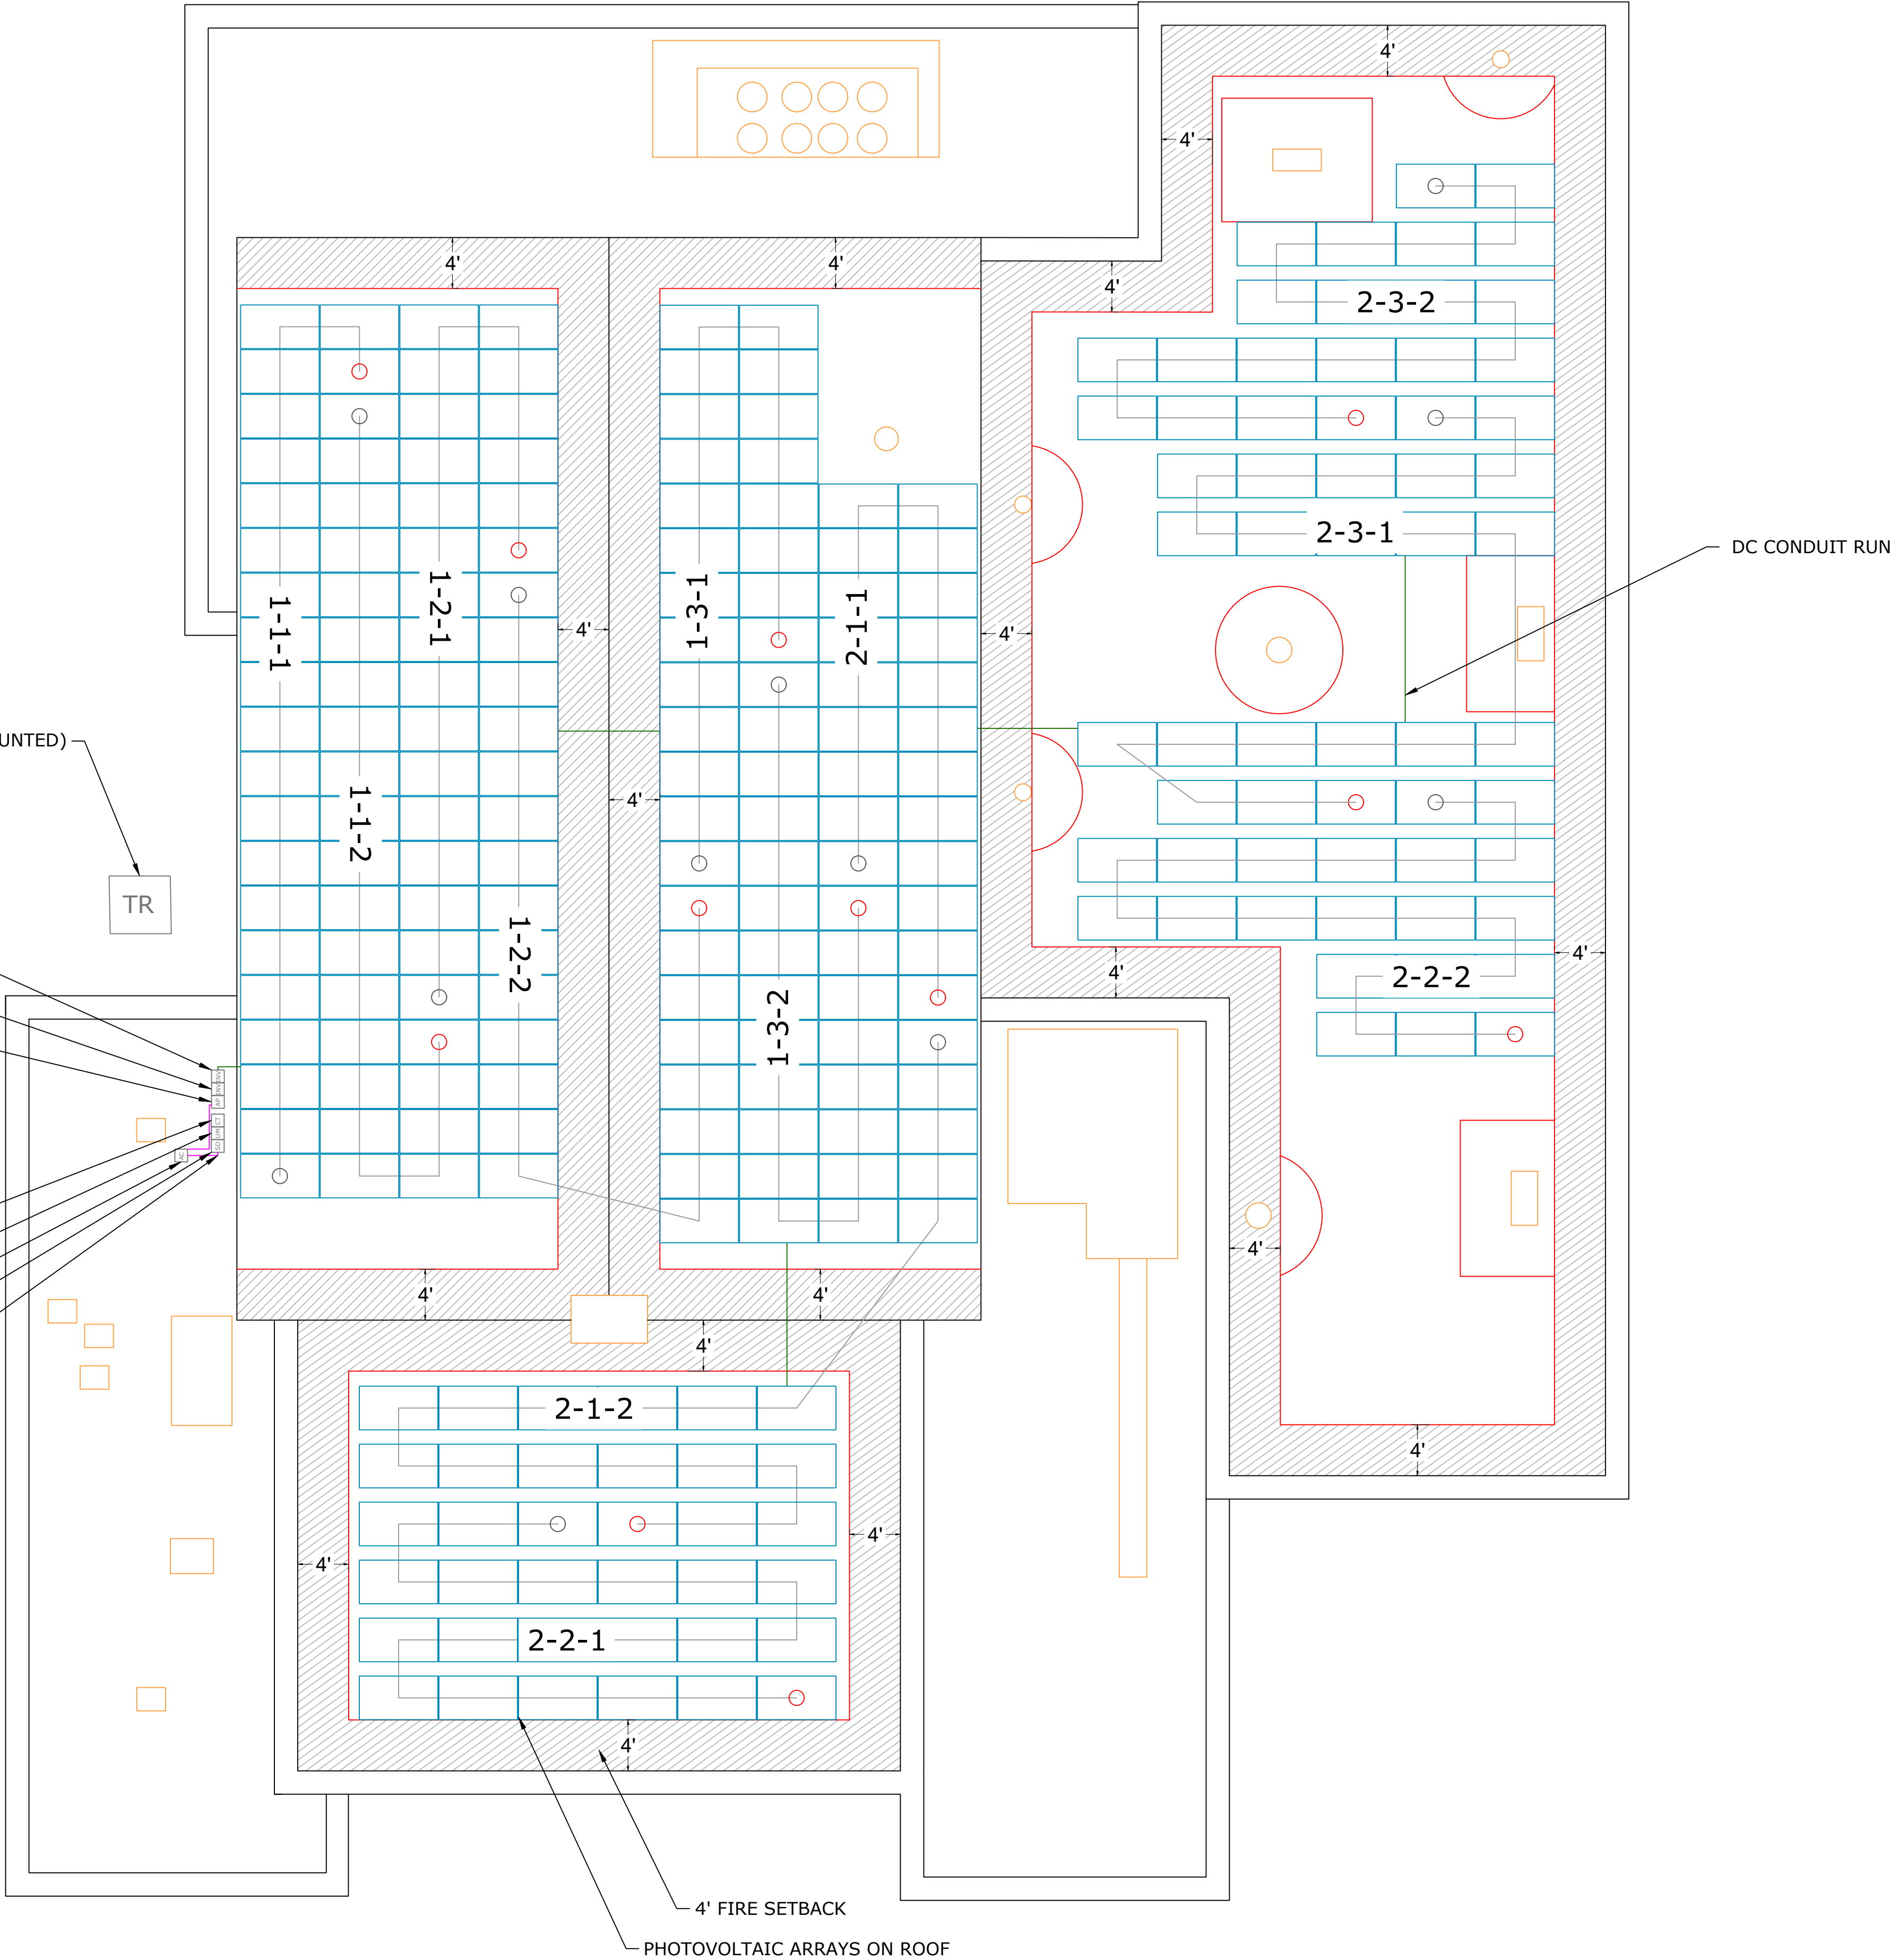

SCALE:1/8" = 1'-0"



AMERICAN MICROGRID
SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
(253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)

INVERTERS:
(2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)

OPTIMIZER/MLPE:
(129)SOLAREEDGE P1101 POWER OPTIMIZER

WIND SPEED: **130MPH**
SNOW LOAD: **61PSF**
EXPOSURE CAT.: **B**

AHJ:**VA-CITY OF ALEXANDRIA**

UTILITY:**DOMINION ENERGY**

MIN. TEMP.: **-11°C** MAX. TEMP.: **35.1°C**

SOLAR PV PROJECT:

DURANT RECREATION CENTER
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY		
REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE

ILLUMINE i

ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

ELECTRICAL STRING PLAN


DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"


SCALE: AS NOTED REV:B

DATE: 06/17/2025 E-02


GROUND LUG DETAIL:

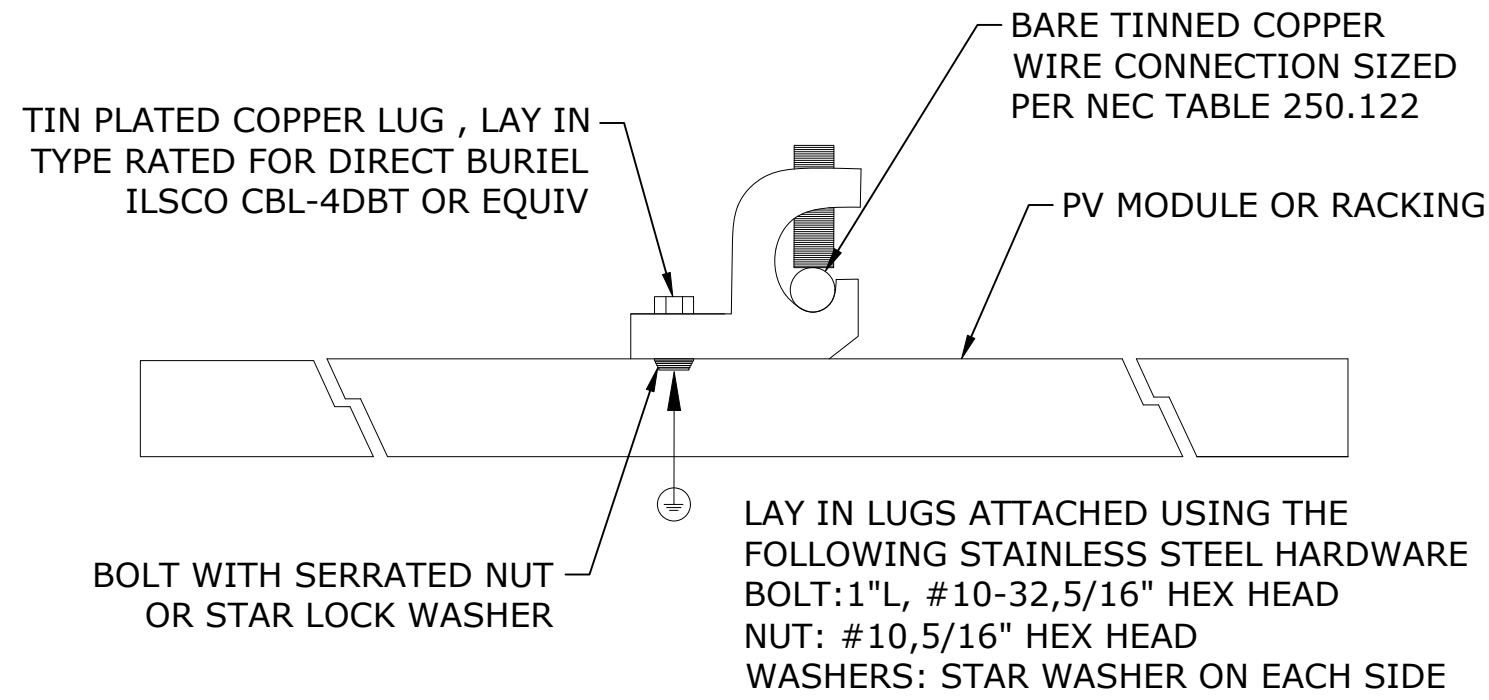


CONDUIT BODY GROUNDING DETAIL:

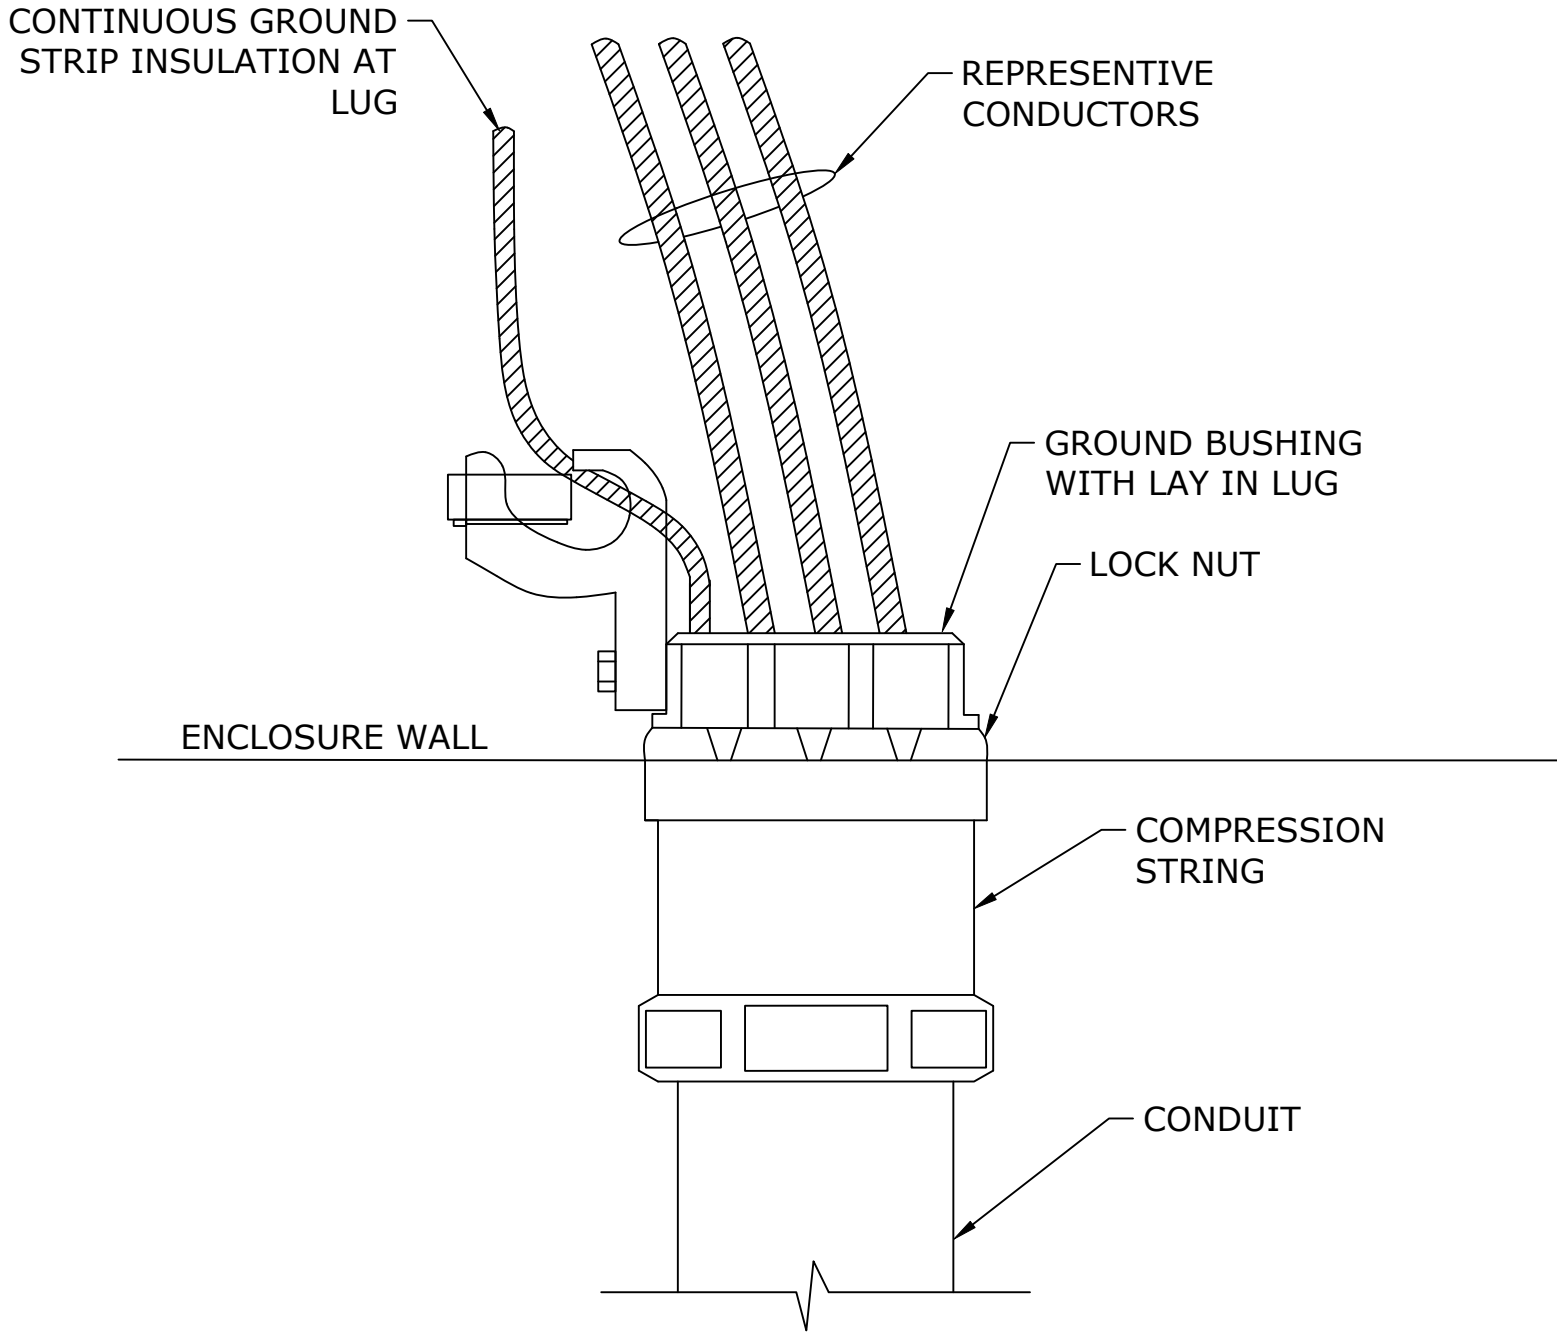


FIRE WALL PENETRATION DETAIL:

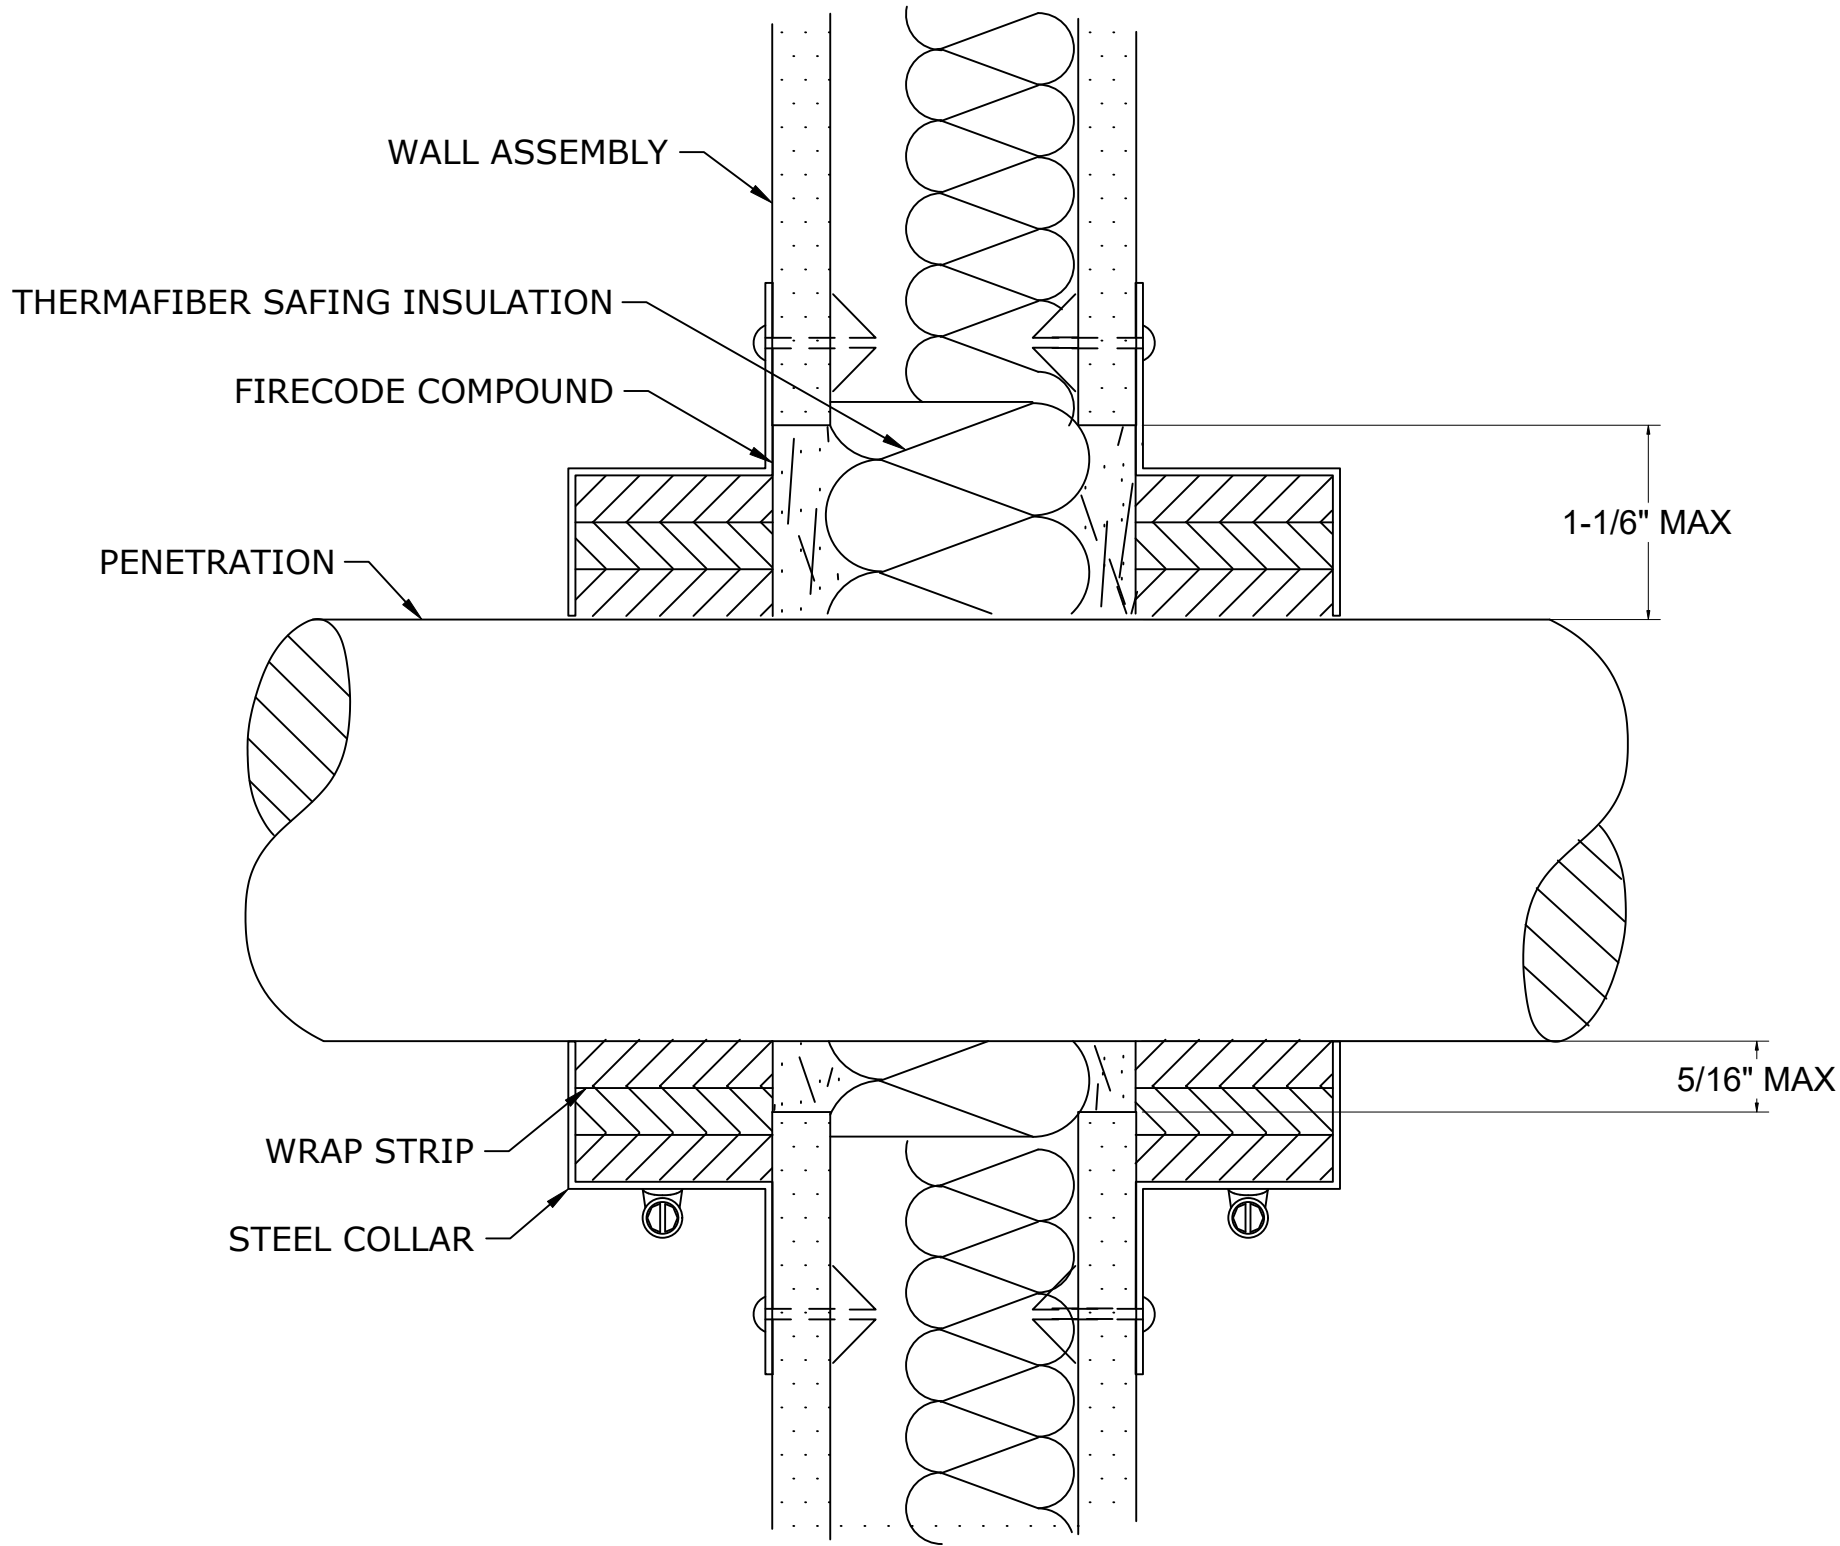

CONDUIT WALL ANCHORING:

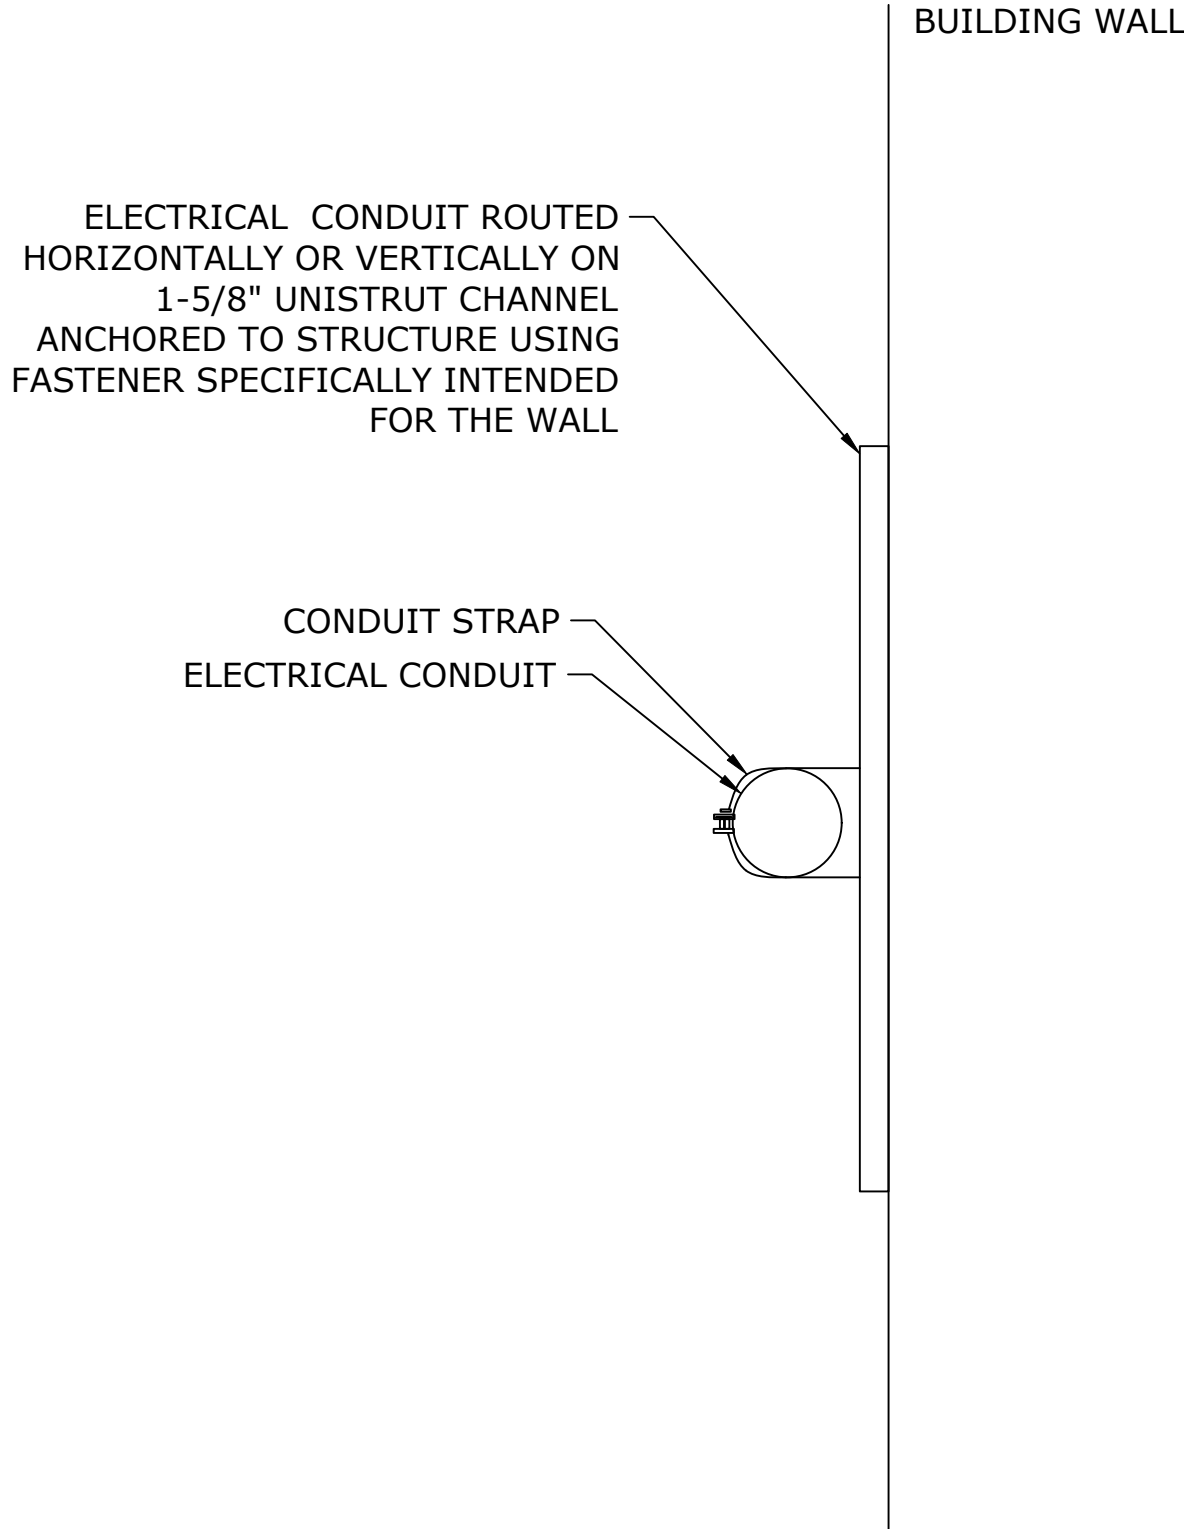

TYPICAL DURA-BLOCK CONDUIT SUPPORT DETAIL:

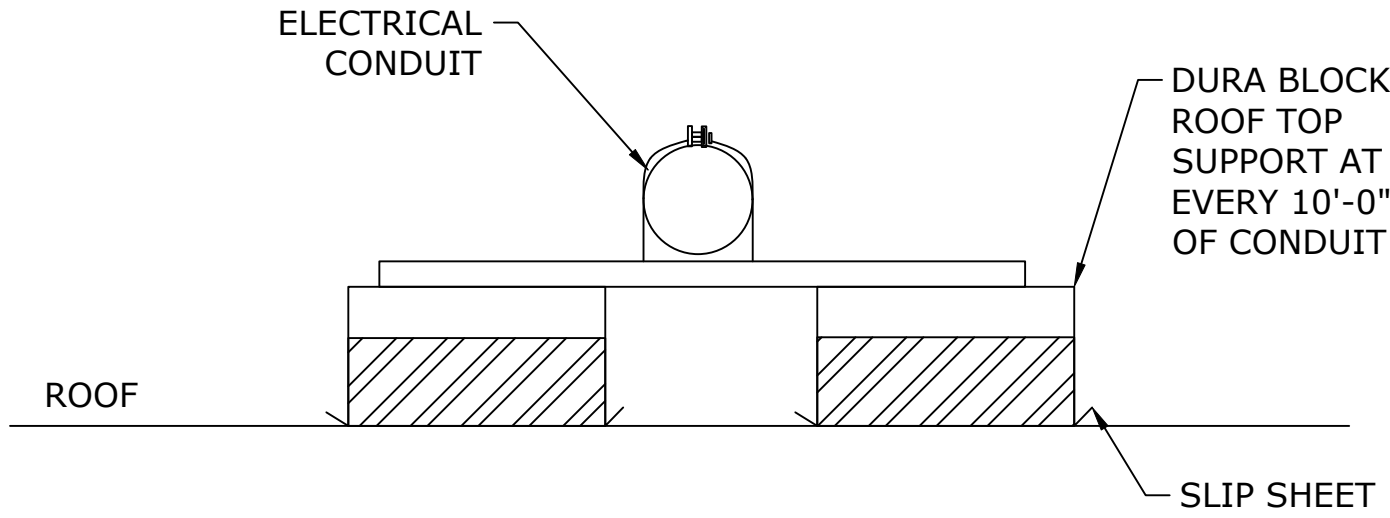

NOTE: REQUIRE CONTRACTOR SUBMITTALS FOR ALL ROOF AND WALL PENETRATIONS. PENETRATIONS THROUGH FIRE RATED CONDITIONS SHOULD REFERENCE UL APPROVED, OR OTHER SIMILAR APPROVED TESTING LAB SYSTEMS (E.G., BY INTERTEK, FM, OR OTHERS).

NOTE: DETAIL DRAWINGS ARE FOR REFERENCE ONLY

AMERICAN MICROGRID
SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC): 101.20 kWp DC / 100.00 kW AC	
MODULES: (253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)	
INVERTERS: (2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)	
OPTIMIZER/MLPE: (129)SOLAREEDGE P1101 POWER OPTIMIZER	
WIND SPEED: 130MPH SNOW LOAD: 61PSF EXPOSURE CAT.: B	
AHJ:VA-CITY OF ALEXANDRIA	
UTILITY:DOMINION ENERGY	
MIN. TEMP.: -11°C	MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

**DURANT RECREATION
CENTER**
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE

ILLUMINE i

ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

ELECTRICAL MOUNTING DETAILS

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED


REV:B

DATE: 06/17/2025

E-03

LINE DIAGRAM: DC SYSTEM SIZE: 101.20kWp, AC SYSTEM SIZE: 100.00kW

NOTE:
1.THIS INSTALLATION IS TO BE CONSIDERED SUPERVISED. ALL NEW ADDITIONS AND ALTERATIONS TO ANY EQUIPMENT IDENTIFIED IN THIS DOCUMENT MUST BE MADE WITH ENGINEERING SUPERVISION AND ALL WORK MUST BE COMPLETED BY QUALIFIED PERSONNEL.
2.ALL EQUIPMENT AND TERMINALS MUST BE MINIMUM 75°C RATED.
3.ALL CONDUCTORS ARE COPPER, UNLESS OTHERWISE SPECIFIED.
4.TAPS ARE MADE USING LISTED DEVICES.

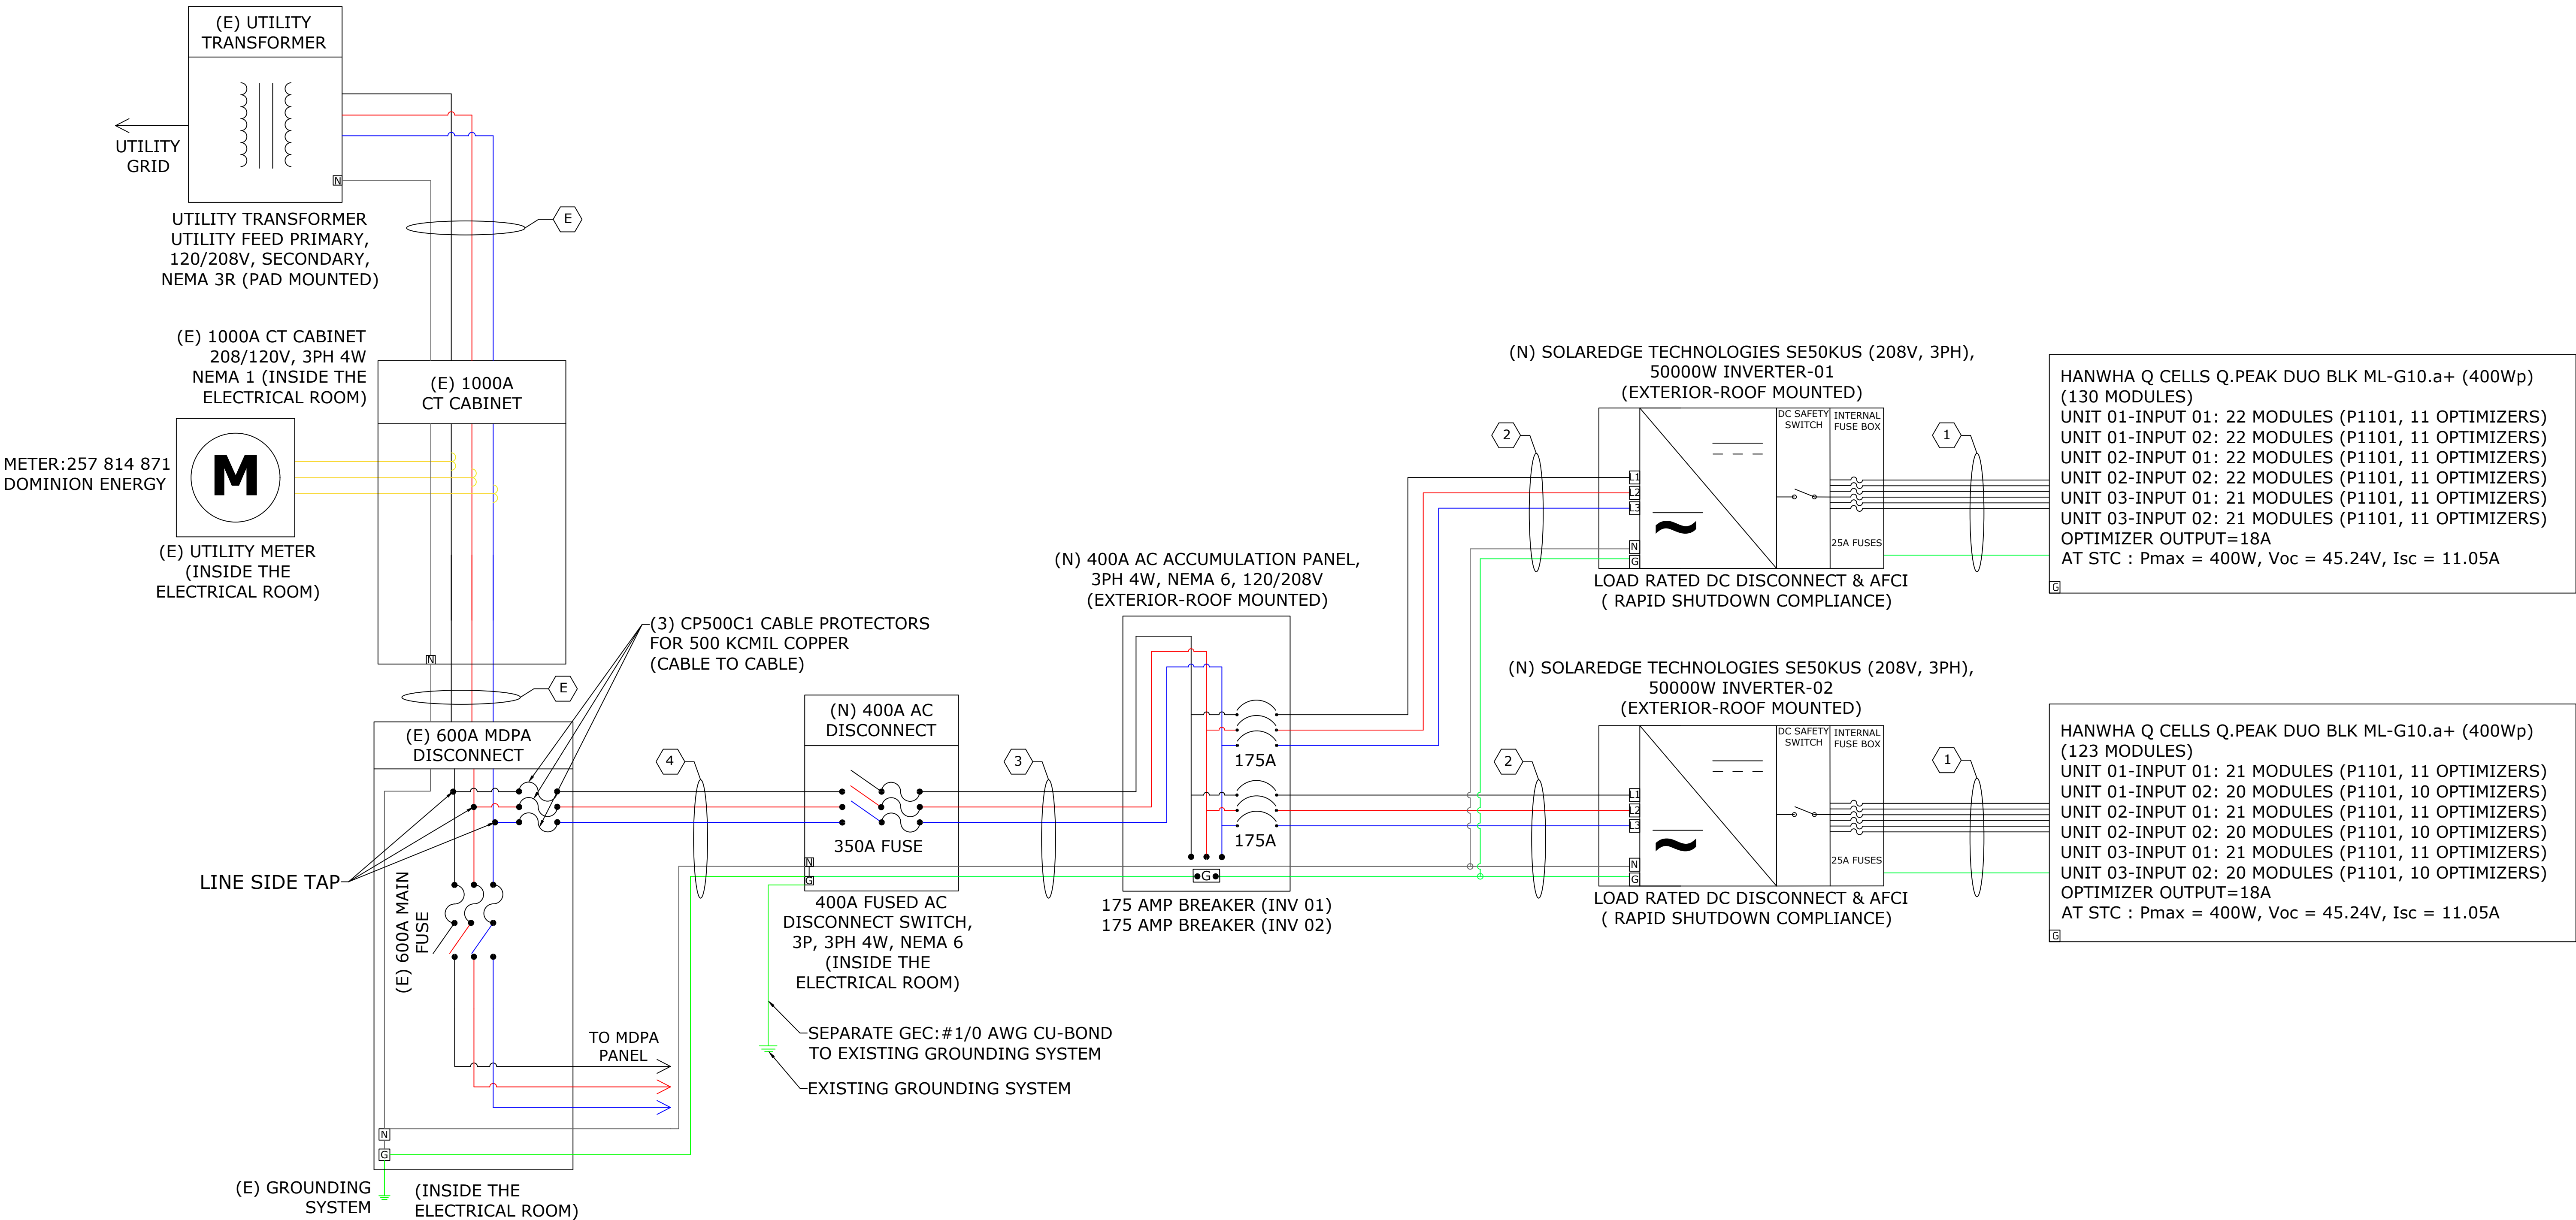

NOTES:
1. EACH SOLAREEDGE P1101 POWER OPTIMIZER IS CONNECTED TO TWO MODULES.
2. EACH SOLAREEDGE P1101 POWER OPTIMIZER IS RAPID SHUTDOWN COMPLIANT.
3. ALL DC FUSES SHOWN ARE CONNECTED INTERNALLY TO THE INVERTER.
4. ADD PULL BOXES IN PLACES WHERE THE CONDUIT RUN BENDS MORE THAN 360 DEGREES.

AMERICAN MICROGRID
SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
(253)HANWHA Q CELLS Q.PEAK DUO
BLK ML-G10.a+ (400Wp)

INVERTERS:
(2)SOLAREEDGE TECHNOLOGIES
SE50KUS (208V, 3PH)

OPTIMIZER/MLPE:
(129)SOLAREEDGE P1101 POWER
OPTIMIZER

WIND SPEED: 130MPH
SNOW LOAD: 61PSF
EXPOSURE CAT.: B

AHJ:VA-CITY OF ALEXANDRIA

UTILITY:DOMINION ENERGY

MIN. TEMP.: -11°C MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

DURANT RECREATION
CENTER

1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381

APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE
INTERNATIONAL INC. THE INFORMATION CONTAINED IN
THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS
WITHOUT THE WRITTEN CONSENT OF ILLUMINE
INTERNATIONAL INC.

LINE DIAGRAM

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED

DATE: 06/17/2025

REV:B

E-04

CONDUIT SCHEDULE					
TAG ID	CONDUIT SIZE	CONDUCTOR	NEUTRAL	GROUND	CONDUIT FILL%
1	1" IMC 1" IMC	(6) 10 AWG PV WIRE 1kV (6) 10 AWG PV WIRE 1kV	NONE	(1) 6 AWG BARE COPPER	33.99 33.99
2	1-1/2" IMC	(3) 2/0 AWG THHN/THWN-2	(1) 6 AWG THHN/THWN-2	(1) 6 AWG THHN/THWN-2	32.80
3	3" IMC	(3) 500 KCMIL THHN/THWN-2	(1) 3 AWG THHN/THWN-2	(1) 3 AWG THHN/THWN-2	27.88
4	3" EMT	(3) 500 KCMIL THHN/THWN-2	(1) 1/0 AWG THHN/THWN-2	(1) 1/0 AWG THHN/THWN-2	26.83

OC PD CALCULATIONS

MDPA DISCONNECT RATING: 600A
LINE SIDE TAP INTERCONNECTION ALLOWABLE BACKFEED IS 600A
OC PD CALCULATIONS: INVERTER OVERCURRENT PROTECTION = INVERTER O/P I X # OF INVERTERS X 1.25
=(139.5A X 2) X 1.25 = 348.75A => PV BREAKER/FUSE = 350A
TOTAL REQUIRED PV BREAKER/FUSE SIZE => 350A PV BREAKER/FUSE
THE DESIGNED INTERCONNECTION MEETS THE 705.11 REQUIREMENTS.

ELECTRICAL CALCULATIONS:

SYSTEM INFO:
101.20 kWp DC SYSTEM SIZE
(253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp) MODULES,
(2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)
(129)SOLAREEDGE P1101 POWER OPTIMIZER
SYSTEM CHARACTERISTICS: (INV-01)
VMP - MAXIMUM POWER POINT VOLTAGE = 370V
VOC - MAXIMUM INVERTER SYSTEM VOLTAGE = 600V
IMP - RATED MAXIMUM POWER-POINT CURRENT = 139.5A
ISC - MAXIMUM CIRCUIT CURRENT = 139.5A
SYSTEM CHARACTERISTICS: (INV-02)
VMP - MAXIMUM POWER POINT VOLTAGE = 370V
VOC - MAXIMUM INVERTER SYSTEM VOLTAGE = 600V
IMP - RATED MAXIMUM POWER-POINT CURRENT = 132.97A
ISC - MAXIMUM CIRCUIT CURRENT = 139.5A
DC WIRE SIZING: (TAG-1)
MAX CIRCUIT CURRENT = OPTIMIZER OUTPUT X 1.25 = 18A X 1.25 = 22.50A
ADJUSTED CONDUCTOR AMPACITY = (HIGH TEMP) [PER TABLE 310.15(B)(1)] X (CONDUIT FILL) [PER TABLE 310.15(C)(1)] X (CONDUCTOR AMPACITY) [PER TABLE 310.16] = 0.91 X 0.8 X 40A = 29.12A
TERMINAL RATING, [PER NEC 110.14(C)] - 10 AWG, 60°C RATED = 30A
30A > 22.50A, SO THE ADJUSTED CONDUCTOR AMPACITY GOVERNS THE CONDUCTOR SIZING
ALSO, 29.12A > 18.00A, AND **10 AWG** IS SUFFICIENT.
AC WIRE SIZING: (TAG-2)
MAX AC OUTPUT CURRENT = MAX INVERTER OUTPUT X 1.25 = 139.5A X 1.25 = 174.38A
ADJUSTED CONDUCTOR AMPACITY = (HIGH TEMP) [PER TABLE 310.15(B)(1)] X (CONDUIT FILL) [PER TABLE 310.15(C)(1)] X (CONDUCTOR AMPACITY) [PER TABLE 310.16] = 0.91 X 1 X 195A = 177.45A
TERMINAL RATING, [PER NEC 110.14(C)] - 2/0 AWG , 75°C RATED = 175A
175A >174.38A, SO THE TERMINAL RATING GOVERNS THE CONDUCTOR SIZING
ALSO, 177.45A >139.5A, AND **2/0 AWG** IS SUFFICIENT
INVERTER OVER CURRENT PROTECTION
(INVERTER MAX CURRENT) X 1.25 = 139.5A X 1.25 = 174.38A --> 175A OVERCURRENT PROTECTION
AC ACCUMULATION PANEL TO POINT INTERCONNECTION: (TAG-3 & 4)
MAX AC OUTPUT CURRENT = MAX INVERTER OUTPUT X # OF INVERTERS X 1.25 = (139.5 X 2) X 1.25 = 348.75A
ADJUSTED CONDUCTOR AMPACITY = (HIGH TEMP) [PER TABLE 310.15(B)(1)] X (CONDUIT FILL) [PER TABLE 310.15(C)(1)] X (CONDUCTOR AMPACITY) [PER TABLE 310.16] = 0.91 X 1 X 430A = 391.3A
TERMINAL RATING, [PER NEC 110.14(C)] - 500 KCMIL , 75°C RATED = 380A
380A >348.75A, SO THE TERMINAL RATING GOVERNS THE CONDUCTOR SIZING
ALSO, 391.3A >279.0A, AND **500 KCMIL** IS SUFFICIENT
OVER CURRENT PROTECTION
(MAX OUTPUT CURRENT) X # OF INVERTERS X 1.25 = (139.5 X 2) X 1.25 = 348.75A --> 350A OVERCURRENT PROTECTION

MODULE SPECIFICATION	
MODEL	HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)
MODULE POWER @ STC	400W
OPEN CIRCUIT VOLTAGE: Voc	45.24V
MAX POWER VOLTAGE: Vmp	37.95V
SHORT CIRCUIT CURRENT: Isc	11.05A
MAX POWER CURRENT: Imp	10.54A

OPTIMIZER CHARACTERISTICS	
MODEL	SOLAREEDGE P1101 POWER OPTIMIZER
MAX INPUT VOLTAGE	125 VDC
MAX OUTPUT VOLTAGE	80 VDC
MAX INPUT CURRENT	14.1 ADC
MAX OUTPUT CURRENT	18 ADC

SPECIFICATIONS	INVERTER-01 & 02
MODEL	SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)
POWER RATING	50000W
MAX OUTPUT CURRENT	139.5A
CEC WEIGHTED EFFICIENCY	97%
MAX INPUT CURRENT	139.5A
MAX DC VOLTAGE	600V

AMERICAN MICROGRID
SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC): 101.20 kWp DC / 100.00 kW AC	
MODULES: (253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)	
INVERTERS: (2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)	
OPTIMIZER/MLPE: (129)SOLAREEDGE P1101 POWER OPTIMIZER	
WIND SPEED: 130MPH SNOW LOAD: 61PSF EXPOSURE CAT.: B	
AHJ: VA-CITY OF ALEXANDRIA	
UTILITY: DOMINION ENERGY	
MIN. TEMP.: -11°C	MAX. TEMP.: 35.1°C

DC VOLTAGE DROP CALCULATION

SOURCE	TERMINATION	TAG	CONDUIT TYPE	CURRENT (IMP)	STRING VOLTAGE AT 2%DB (VMP)	#SET OF PARALLEL CONDUCTOR	CONDUCTOR	CONDUCTOR MATERIAL	RESISTANCE AT 75 DEG C	RESISTANCE AT 2%DB	MAX CONDUTOR LENGTH(ft)	%V.DROP
MODULES	INVERTER 01	1	IMC	18	370	1	C AWG 10	Cu	0.00124	0.001080193	120	1.26%
MODULES	INVERTER 02	1	IMC	18	370	1	C AWG 10	Cu	0.00124	0.001080193	180	1.89%

MAX Vdrop	1.89%
AVERAGE Vdrop	1.58%

3 PHASE AC VOLTAGE DROP CALCULATION

SOURCE	TERMINATION	TAG	CONDUIT TYPE	CURRENT	VOLTAGE	#SET OF PARALLEL CONDUCTOR	CONDUCTOR	CONDUCTOR MATERIAL	RESISTANCE AT 75 DEG C	RESISTANCE AT 2%DB	MAX CONDUTOR LENGTH(ft)	%V.DROP
INVERTER TO COLLECTION												
INVERTER 01	AC ACCUMULATION PANEL	2	IMC	139.5	208	1	K AWG 2/0	Cu	0.000100	0.000087112	10	0.10%
INVERTER 02	AC ACCUMULATION PANEL	2	IMC	139.5	208	1	K AWG 2/0	Cu	0.000100	0.000087112	10	0.10%

COLLECTION TO POI

AC ACCUMULATION PANEL	AC DISCONNECT	3	IMC	279	208	1	R 500 KCMIL	Cu	0.000032	0.000027876	15	0.10%
AC DISCONNECT	POI	4	EMT	279	208	1	R 500 KCMIL	Cu	0.000032	0.000027876	10	0.06%
											MAX Vdrop	0.26%
											AVERAGE Vdrop	0.26%
											TOTAL SYSTEM VDROP	2.15%

SOLAR PV PROJECT:

**DURANT RECREATION
CENTER**
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

ELECTRICAL CALCULATIONS & VOLTAGE
DROP CALCULATIONS

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI




PAPER SIZE: 24" X 36"

SCALE: AS NOTED

REV:B

DATE: 06/17/2025

E-05

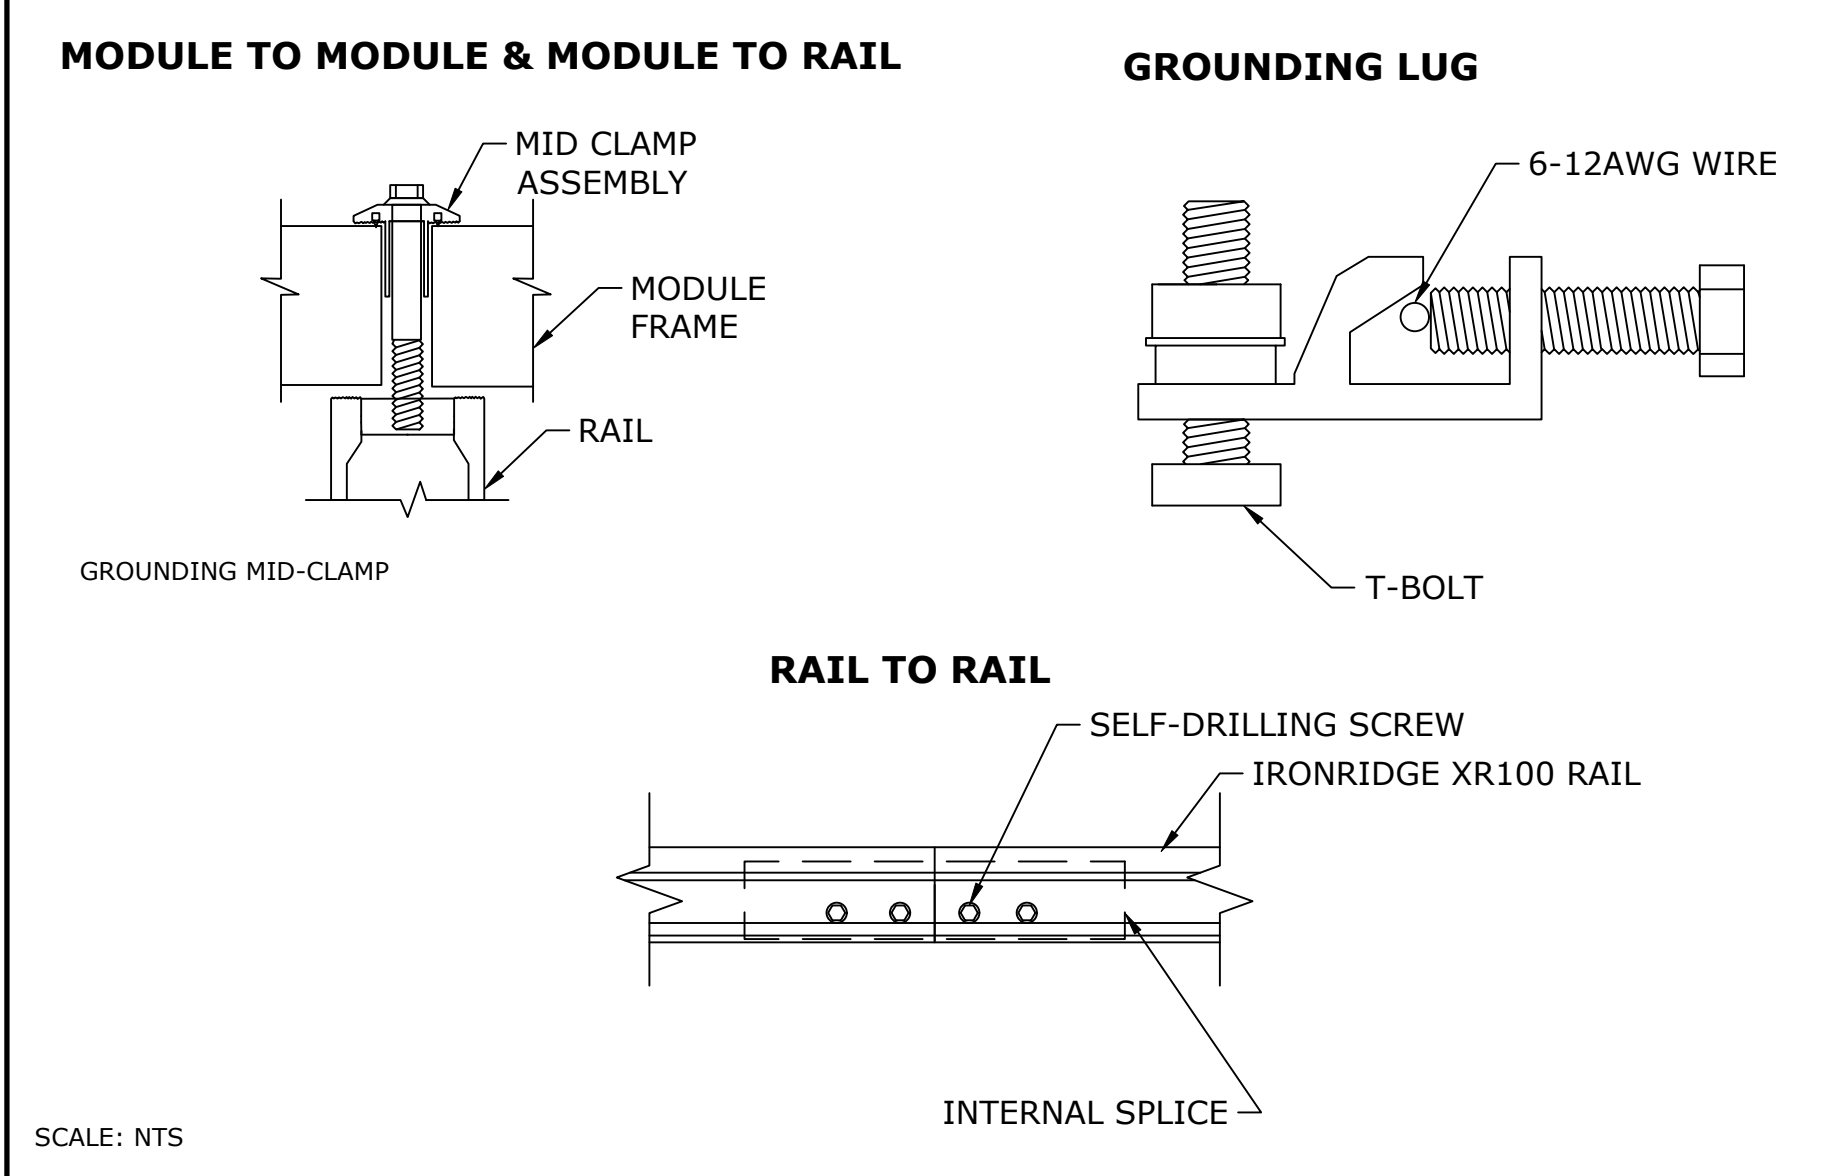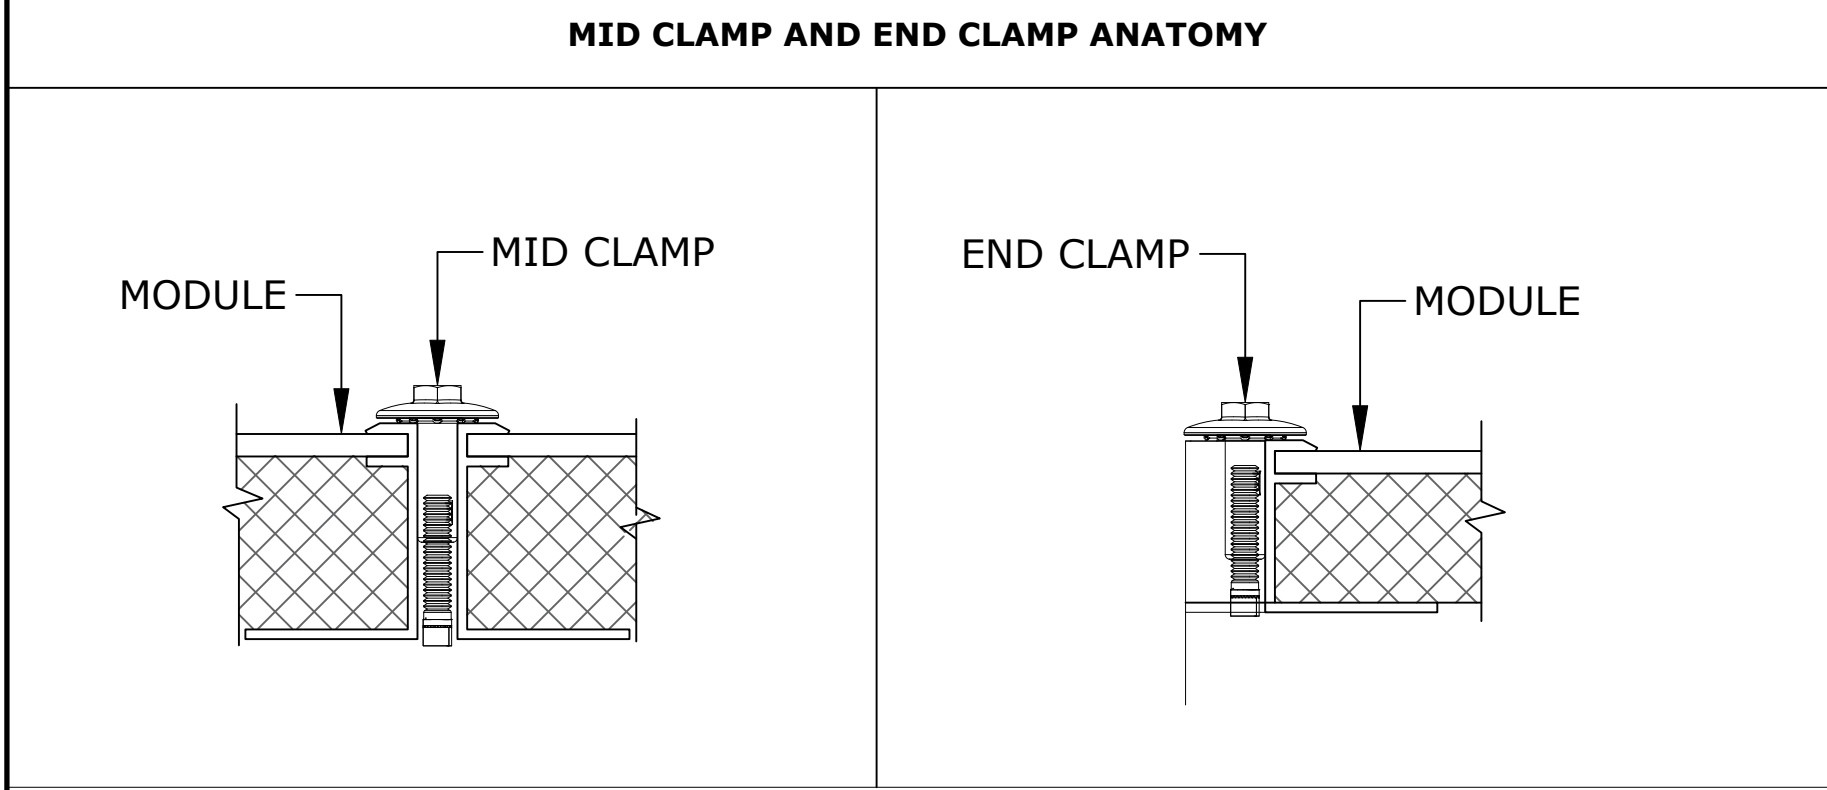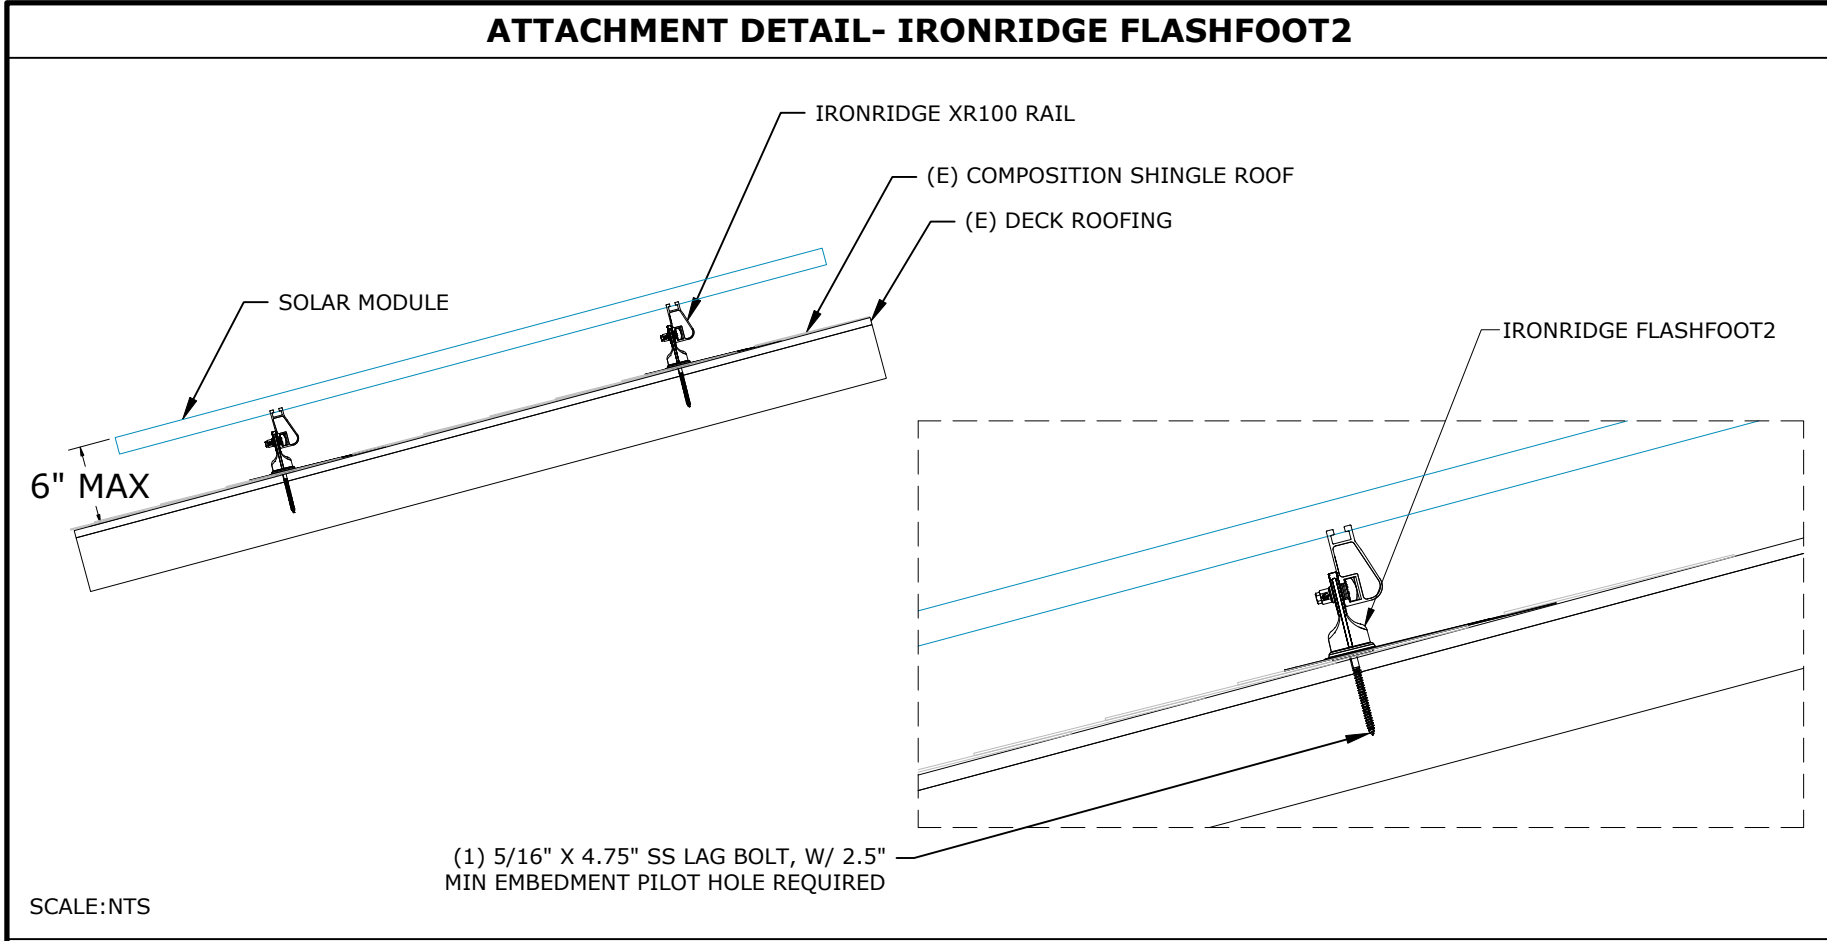

SITE INFORMATION - WIND SPEED: 130 MPH AND SNOW LOAD: 61 PSF									
SR. NO	AZIMUTH	ROOF TILT	MODULE TILT	NO. OF MODULES	ARRAY AREA (SQ. FT.)	ROOF TYPE	ATTACHMENT	MAX ATTACHMENT SPAN	OVER HANG
MP-01	279°	27°	0°	80	1689.7	COMPOSITION SHINGLE	IRONRIDGE FLASHFOOT2	4'-0"	1'-6"
MP-02	99°	27°	0°	76	1605.2	COMPOSITION SHINGLE	IRONRIDGE FLASHFOOT2	4'-0"	1'-6"

GENERAL STRUCTURAL NOTES
1.ALL EQUIPMENTS SHALL BE INSTALLED PER MANUFACTURER INSTALLATION AND OPERATIONS MANUAL REQUIREMENTS.
2.PRIOR TO COMMENCEMENT OF WORK OR FABRICATION OF COMPONENTS, THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS,AND ELEVATIONS OF THE EXISTING CONSTRUCTION.CONTRACTOR SHALL NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN THE FIELD -VERIFIED CONDITIONS, DIMENSIONS,AND ELEVATION AND THOSE INDICATED ON THE DRAWINGS.
3.ALL THE CONSTRUCTION SHALL COMPLY WITH REQUIREMENTS OF 2021 EDITION OF THE VIRGINIA CONSTRUCTION CODE.
SOLAR RACK COMPONENTS:
1. FOLLOW MANUFACTURER'S INSTALLATION FOR INSTALLATION OF THE SOLAR COMPONENTS,INCLUDING MODULE CLAMPS, L-FEET, BRACKETS MECHANICAL ATTACHMENTS,AND HARDWARE.

DEAD LOAD CALCULATIONS			
BOM	QUANTITY	LBS/UNIT	TOTAL WEIGHT (LBS)
MODULES	156	48.5	12270.50
MID-CLAMP	124	0.050	6.20
END-CLAMP	16	0.050	0.80
RAIL LENGTH	560	0.680	380.80
SPLICE BAR	32	0.360	11.52
IRONRIDGE FLASHFOOT 2	290	0.88	255.20
TOTAL WEIGHT OF THE SYSTEM (LBS)			12925.02
TOTAL ARRAY AREA ON THE ROOF (SQ. FT.)			1393.98
WEIGHT PER SQ. FT.(LBS)			9.27
WEIGHT PER PENETRATION (LBS)			44.57

AMERICAN MICROGRID SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
(253)HANWHA Q CELLS Q.PEAK DUO BLK ML-G10.a+ (400Wp)

INVERTERS:
(2)SOLAREEDGE TECHNOLOGIES SE50KUS (208V, 3PH)

OPTIMIZER/MLPE:
(129)SOLAREEDGE P1101 POWER OPTIMIZER

WIND SPEED: 130MPH
SNOW LOAD: 61PSF
EXPOSURE CAT.: B

AHJ:VA-CITY OF ALEXANDRIA

UTILITY:DOMINION ENERGY

MIN. TEMP.: -11°C MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

DURANT RECREATION CENTER
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY		
REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE

ILLUMINE i

ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.


STRUCTURAL DETAIL & ARRAY PLAN-01

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI


PAPER SIZE: 24" X 36"

SCALE: AS NOTED REV:B

DATE: 06/17/2025 S-01

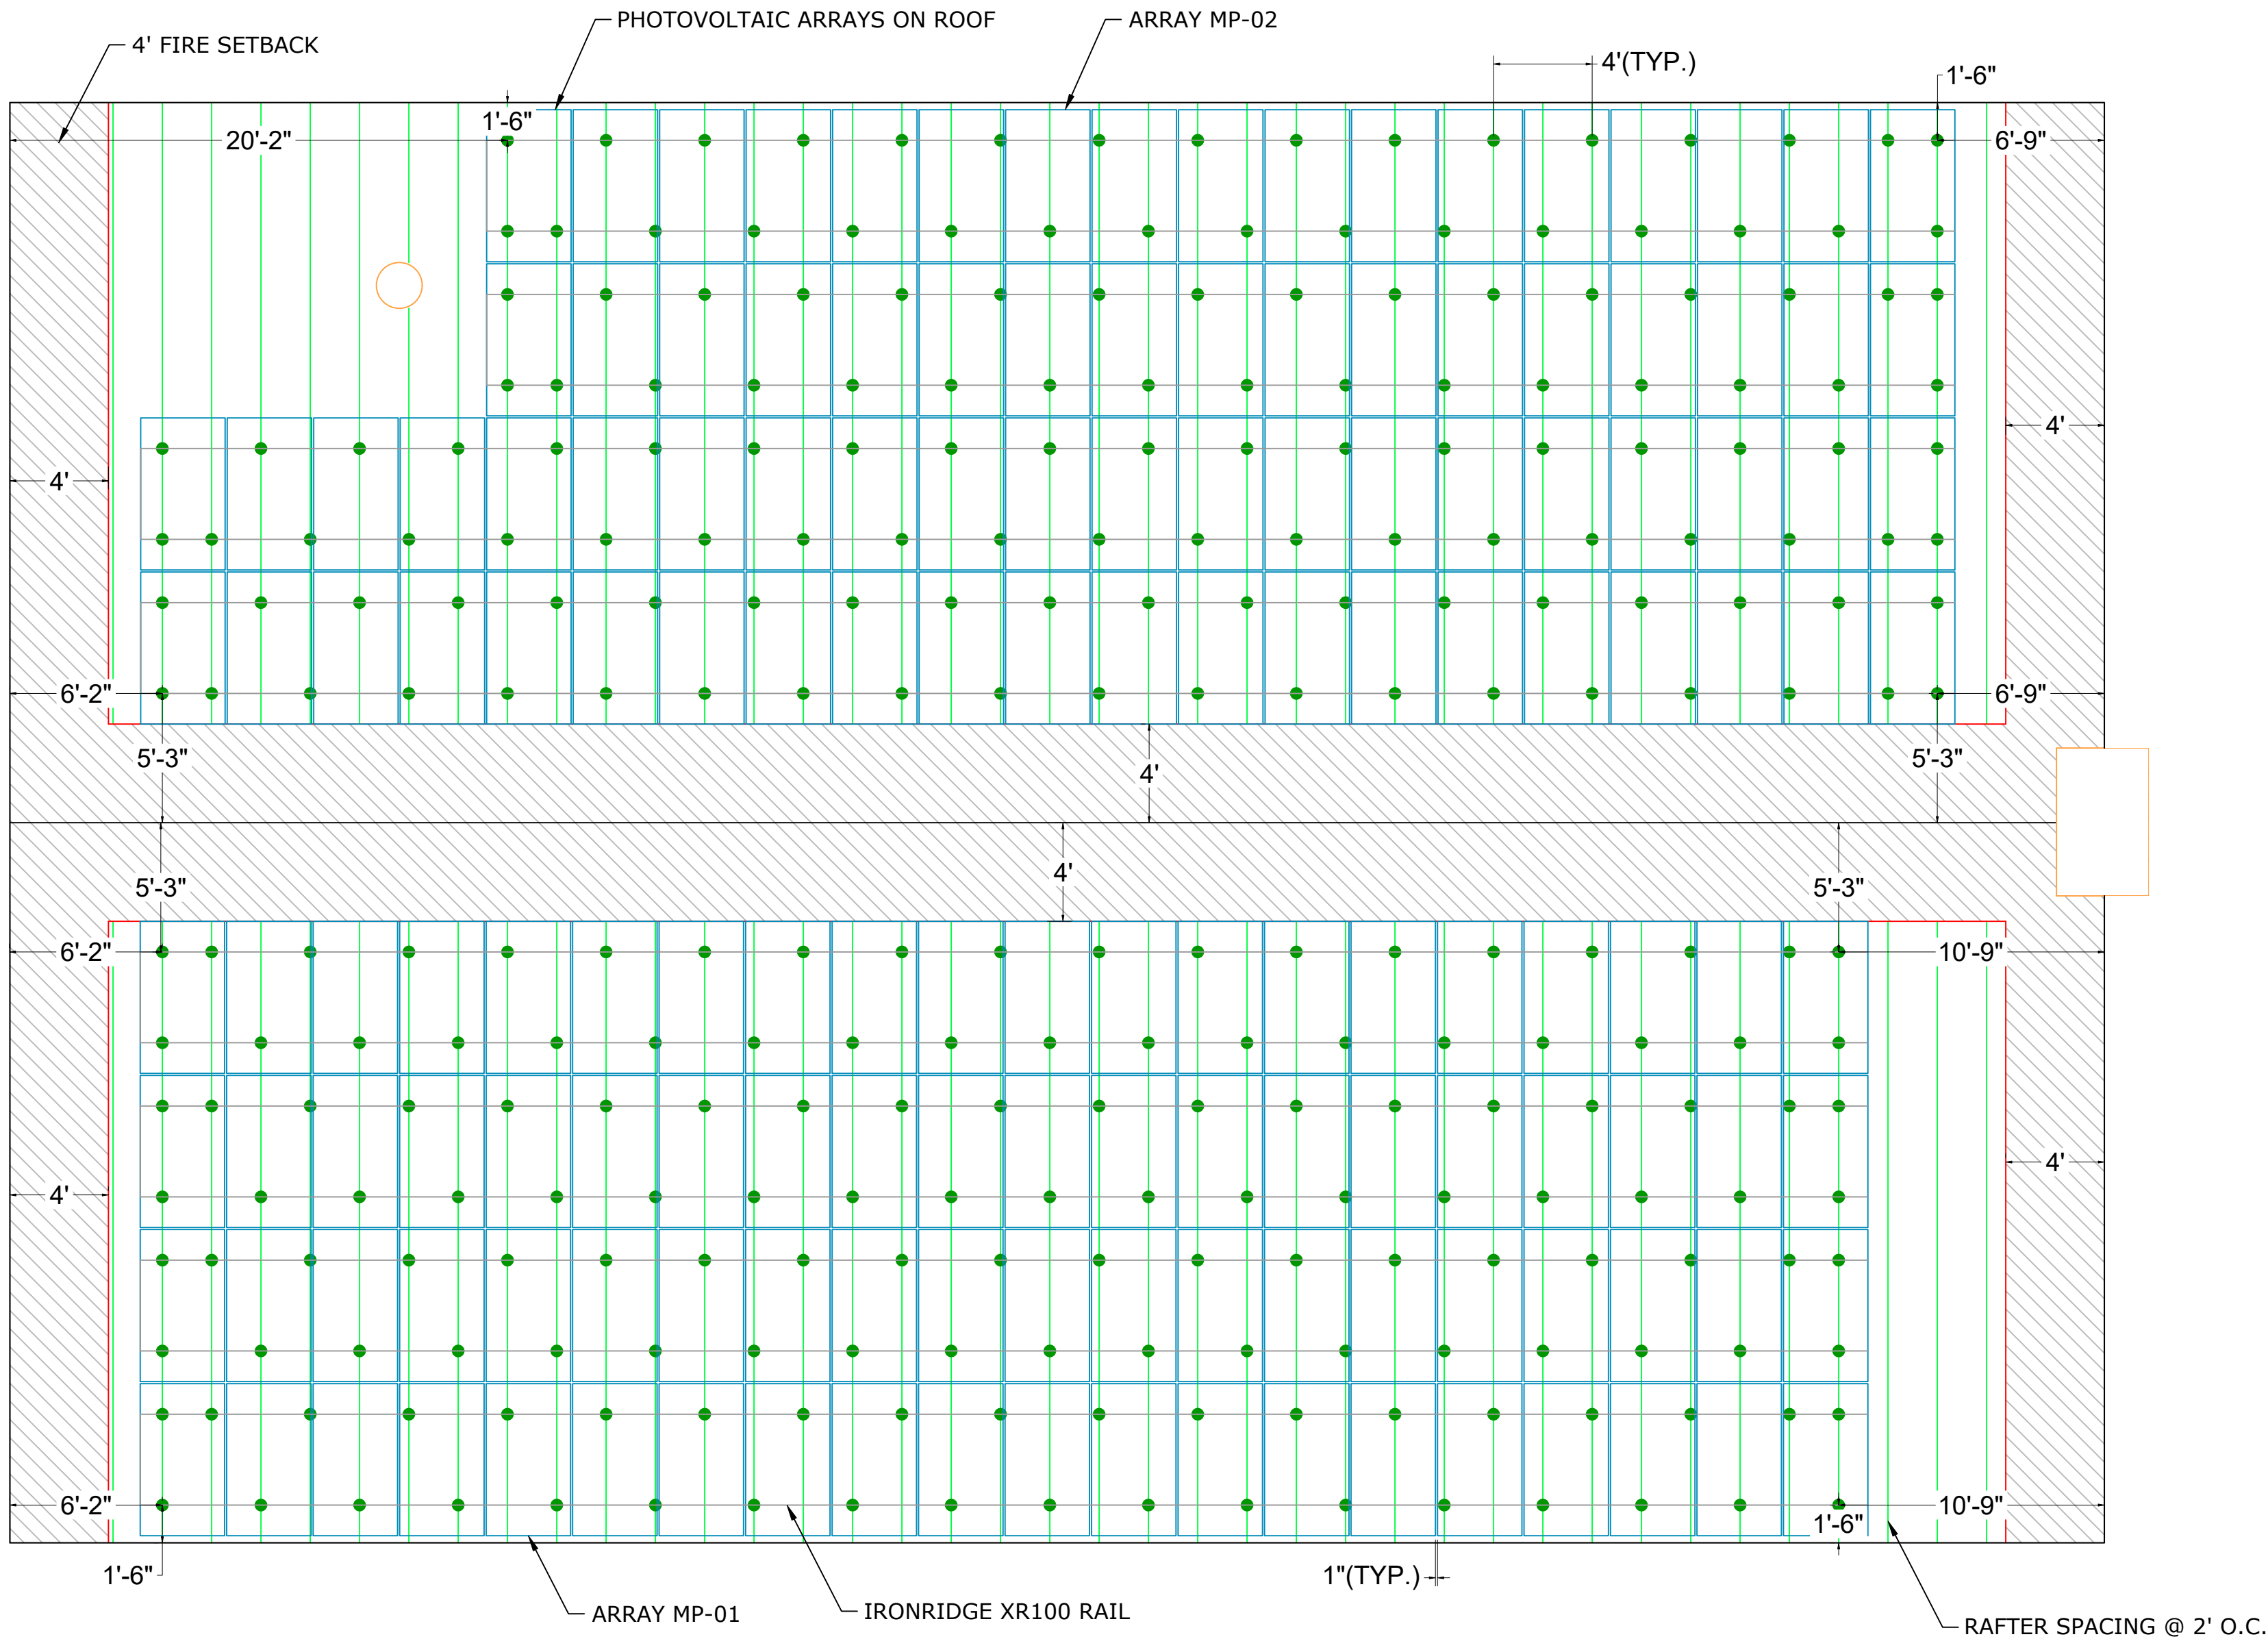

SCALE:3/16" = 1'-0"



ELEVATION

SIDE VIEW

PROFILE VIEW

FLASHLOC RM KIT

NOTES
 PROVIDE (8) #14 FULLY THREADED STS SCREWS FULLY EMBEDDED TO ROOF DECKING AT EACH ATTACHMENT POINT



SITE INFORMATION - WIND SPEED: 130 MPH, WIND EXPOSURE: B AND SNOW LOAD: 61 PSF							
SR. NO	AZIMUTH	ROOF SLOPE	MODULE TILT	NO. OF MODULES	ARRAY AREA (SQ. FT.)	ROOF TYPE	ATTACHMENT
ARRAY MP-03	189°	0°	10°	36	1040	EPDM	UNIRAC RM10 EVO WITH FLASHLOC RM ATTACHMENT
ARRAY MP-04	189°	0°	10°	29	853	EPDM	UNIRAC RM10 EVO WITH FLASHLOC RM ATTACHMENT
ARRAY MP-05	189°	0°	10°	32	929	EPDM	UNIRAC RM10 EVO WITH FLASHLOC RM ATTACHMENT

BILL OF MATERIALS				
SL. NO.	PART NUMBER	PART TYPE	DESCRIPTION	QUANTITY
1	USER SUPPLIED	BALLAST BLOCK	BALLAST BLOCK	270
2	370010	BALLAST BAY	RM 10 EVO FIELD BAY	138
3	370023	CLAMP	EVO MOD CLAMP BULK	458
4	310760	RM ROOF PAD	RM ROOF PAD	220
5	370022	RM HEX BOLT	EVO MOD CLAMP SIDE BOLT BULK	458
6	310999	ATTACHMENT	FLASHLOC RM KIT	28
7	310771	ATTACHMENT	RM10 ATTACHMENT KIT	28
8	008115M	WIRE MANAGEMENT	MLPE TIGER CLIP	97

1. ALL EQUIPMENTS SHALL BE INSTALLED PER MANUFACTURER INSTALLATION AND OPERATIONS MANUAL REQUIREMENTS.
2. PRIOR TO COMMENCEMENT OF WORK OR FABRICATION OF COMPONENTS, THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, AND ELEVATIONS OF THE EXISTING CONSTRUCTION. CONTRACTOR SHALL NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN THE FIELD -VERIFIED CONDITIONS, DIMENSIONS, AND ELEVATION AND THOSE INDICATED ON THE DRAWINGS.
3. ALL THE CONSTRUCTION SHALL COMPLY WITH REQUIREMENTS OF 2021 EDITION OF THE VIRGINIA CONSTRUCTION CODE.

1. FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS OF THE SOLAR COMPONENTS, INCLUDING MODULE CLAMPS, L-FEET, BRACKETS, MECHANICAL ATTACHMENTS, AND HARDWARE.


1. BALLAST BLOCKS TO WEIGHT 32 LBS PER MANUFACTURER'S REQUIREMENT

TOTAL AVERAGE PSF	4.88 PSF	LEGEND: <div>  - STANDARD CORNER BAY WITH CMU BLOCK COUNT </div> <div>  - BAY WITH ATTACHMENT </div>
TOTAL NUMBER OF MODULES	97	
TOTAL KW	38.80	
TOTAL AREA SQ FT	~2822	
TOTAL WEIGHT ON ROOF LBS	13782	

(ARRAY-03)AVERAGE PSF	4.93 PSF	(ARRAY-04)AVERAGE PSF	4.89 PSF
TOTAL NUMBER OF MODULES	36	TOTAL NUMBER OF MODULES	29
ROOF SLOPE	0°	ROOF SLOPE	0°
ROW SPACING	13.5°	ROW SPACING	13.5°
TOTAL KW	14.40	TOTAL KW	11.60
TOTAL AREA SQ FT	1040	TOTAL AREA SQ FT	853
TOTAL WEIGHT ON ROOF LBS	5127	TOTAL WEIGHT ON ROOF LBS	4107
RACKING WEIGHT LBS	120	RACKING WEIGHT LBS	105
MODULE WEIGHT LBS	1746	MODULE WEIGHT LBS	1407
BALLAST WEIGHT LBS	3232	BALLAST WEIGHT LBS	2560
TOTAL ATTACHMENT COUNT	8	TOTAL ATTACHMENT COUNT	10
ATTACHMENT KIT WEIGHT LBS	28.48	ATTACHMENT KIT WEIGHT LBS	35.60

(ARRAY-05)AVERAGE PSF	4.89 PSF
TOTAL NUMBER OF MODULES	32
ROOF SLOPE	0°
ROW SPACING	13.5°
TOTAL KW	12.80
TOTAL AREA SQ FT	929
TOTAL WEIGHT ON ROOF LBS	4548
RACKING WEIGHT LBS	113
MODULE WEIGHT LBS	1552
BALLAST WEIGHT LBS	2848
TOTAL ATTACHMENT COUNT	10
ATTACHMENT KIT WEIGHT LBS	35.60

(ARRAY-04)AVERAGE PSF	4.89 PSF
TOTAL NUMBER OF MODULES	29
ROOF SLOPE	0°
ROW SPACING	13.5°
TOTAL KW	11.60
TOTAL AREA SQ FT	853
TOTAL WEIGHT ON ROOF LBS	4107
RACKING WEIGHT LBS	105
MODULE WEIGHT LBS	1407
BALLAST WEIGHT LBS	2560
TOTAL ATTACHMENT COUNT	10
ATTACHMENT KIT WEIGHT LBS	35.60

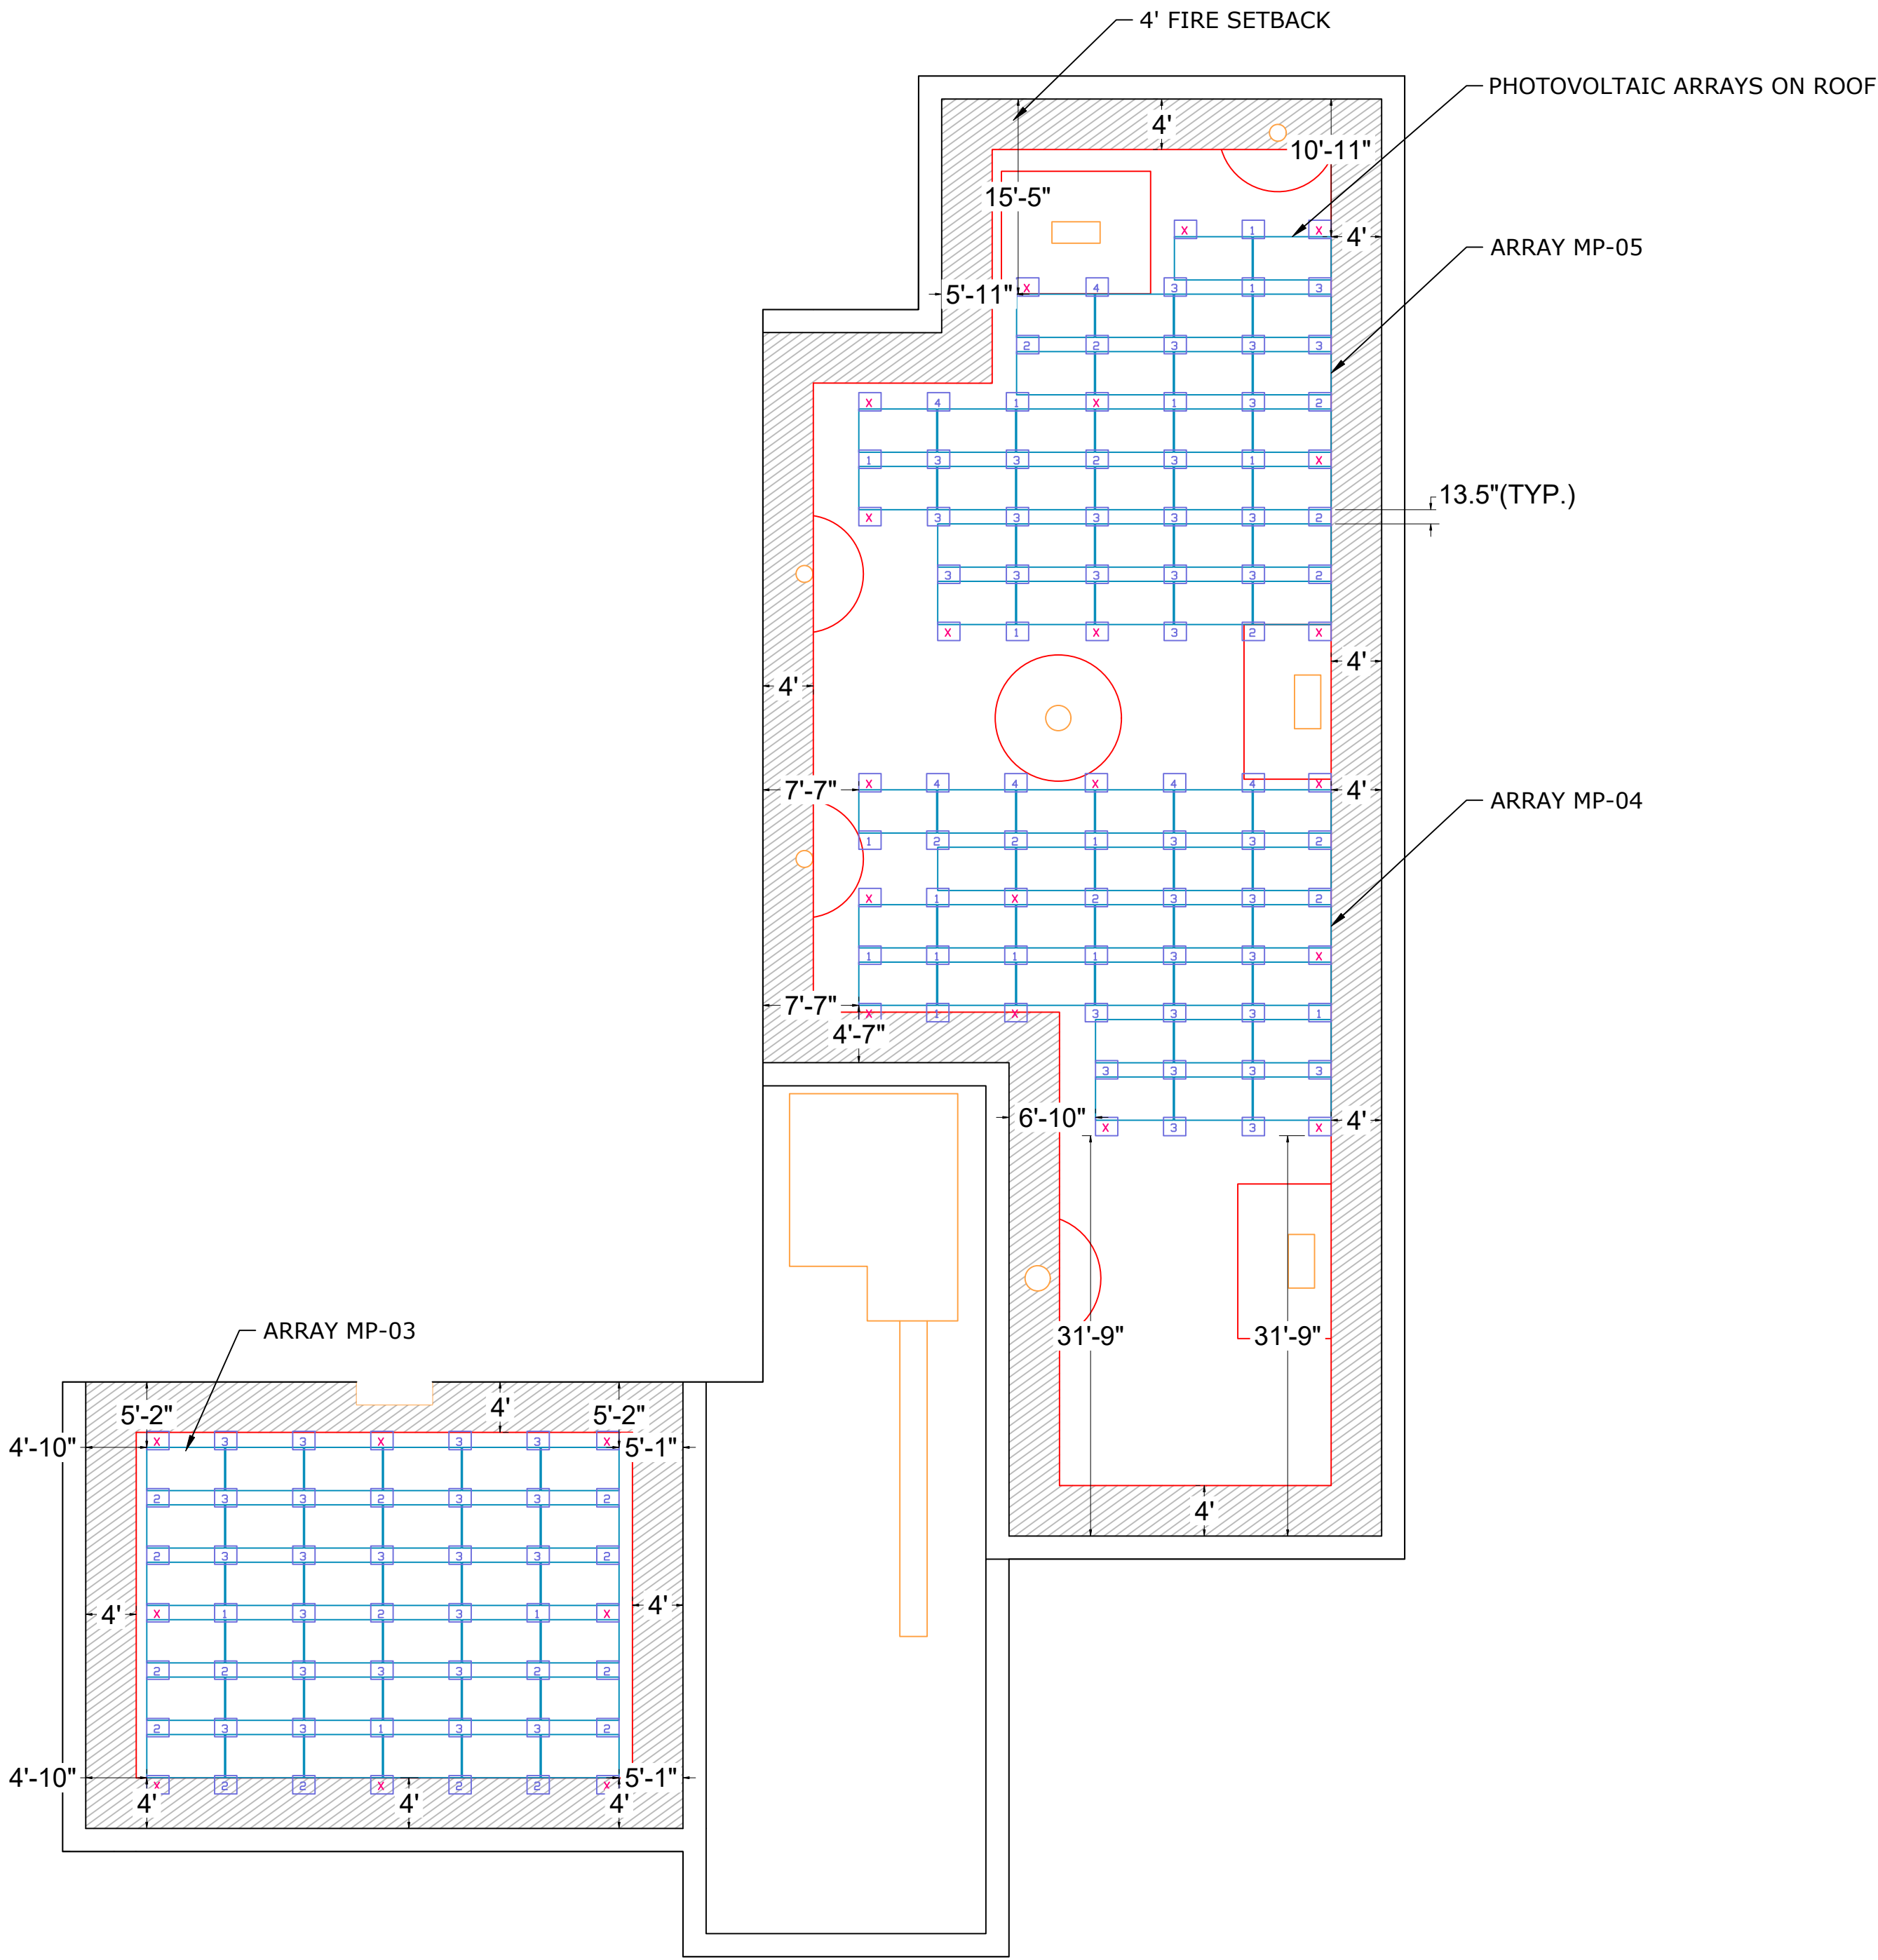

SCALE: 3/32" = 1'-0"

AMERICAN MICROGRID
SOLUTIONS

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
(253)HANWHA Q CELLS Q.PEAK DUO
BLK ML-G10.a+ (400Wp)

INVERTERS:
(2) SOLAREDGE TECHNOLOGIES
SE50KUS (208V, 3PH)

OPTIMIZER/MLPE:
(129)SOLAREEDGE P1101 POWER
OPTIMIZER

WIND SPEED: **130MPH**
SNOW LOAD: **61PSF**
EXPOSURE CAT.: **B**

AHJ:VA-CITY OF ALEXANDRIA

UTILITY: DOMINION ENERGY

MIN. TEMP.: -11°C	MAX. TEMP.: 35.1°C
-------------------	--------------------

**DURANT RECREATION
CENTER
1605 CAMERON ST,
ALEXANDRIA, VA 22314
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499**

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE
INTERNATIONAL INC. THE INFORMATION CONTAINED
IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS
WITHOUT THE WRITTEN CONSENT OF ILLUMINE
INTERNATIONAL INC.

STRUCTURAL DETAIL & ARRAY PLAN-02

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED	REV: B

PLACARDS

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON BOTH LINE AND LOAD SIDE MAY BE ENERGIZED IN THE OPEN POSITION

INSTALLED ON: AC DISCONNECT, LOAD CENTERS, COMBINER PANELS, POINT OF INTERCONNECTION
APPLICABLE CODE(S): NEC 690.13(B)

WARNING:PHOTOVOLTAIC POWER SOURCE

INSTALLED ON: CONDUIT, RACEWAYS, AND J-BOXES (LABELED EVERY 10'). REFLECTIVE. MIN 3/8" WHITE TEXT ON BLACK BACKGROUND
APPLICABLE CODE(S): NEC 690.31(D)(2)

PHOTOVOLTAIC DC DISCONNECT

INSTALLED ON: DC DISCONNECT(S)
APPLICABLE CODE(S): NEC 690.13(B)

INVERTER 1&2

MAXIMUM DC VOLTAGE 600 V OF PV SYSTEM

INSTALLED ON: INVERTER
APPLICABLE CODE(S): NEC 690.53

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

INSTALLED ON: WITHIN 3 FT OF SERVICE DISCONNECTING MEANS. MIN 3/8" BLACK TEXT ON YELLOW BACKGROUND & 3/16" BLACK TEXT ON WHITE BACKGROUND.
APPLICABLE CODE(S): NEC 690.56(C)

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

INSTALLED ON:RAPID SHUTDOWN SWITCH
APPLICABLE CODE(S): NEC 690.56(C)(2)

PHOTOVOLTAIC SYSTEM AC DISCONNECT SWITCH

RATED AC OPERATING CURRENT 279 AMPS AC
AC NOMINAL OPERATING VOLTAGE 208 VAC

INSTALLED ON: AC DISCONNECT(S), POINT OF INTERCONNECTION,
APPLICABLE CODE(S): NEC 690.54

WARNING DUAL POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC SYSTEM


INSTALLED ON: POINT OF INTERCONNECTION
APPLICABLE CODE(S): NEC 705.12(C)

DEDICATED PHOTOVOLTAIC SYSTEM COMBINER PANEL NO LOAD SHALL BE ADDED TO THIS PANEL

INSTALLED ON: COMBINER PANEL

CAUTION:MULTIPLE SOURCES OF POWER

POWER TO THIS BUILDING IS ALSO SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN

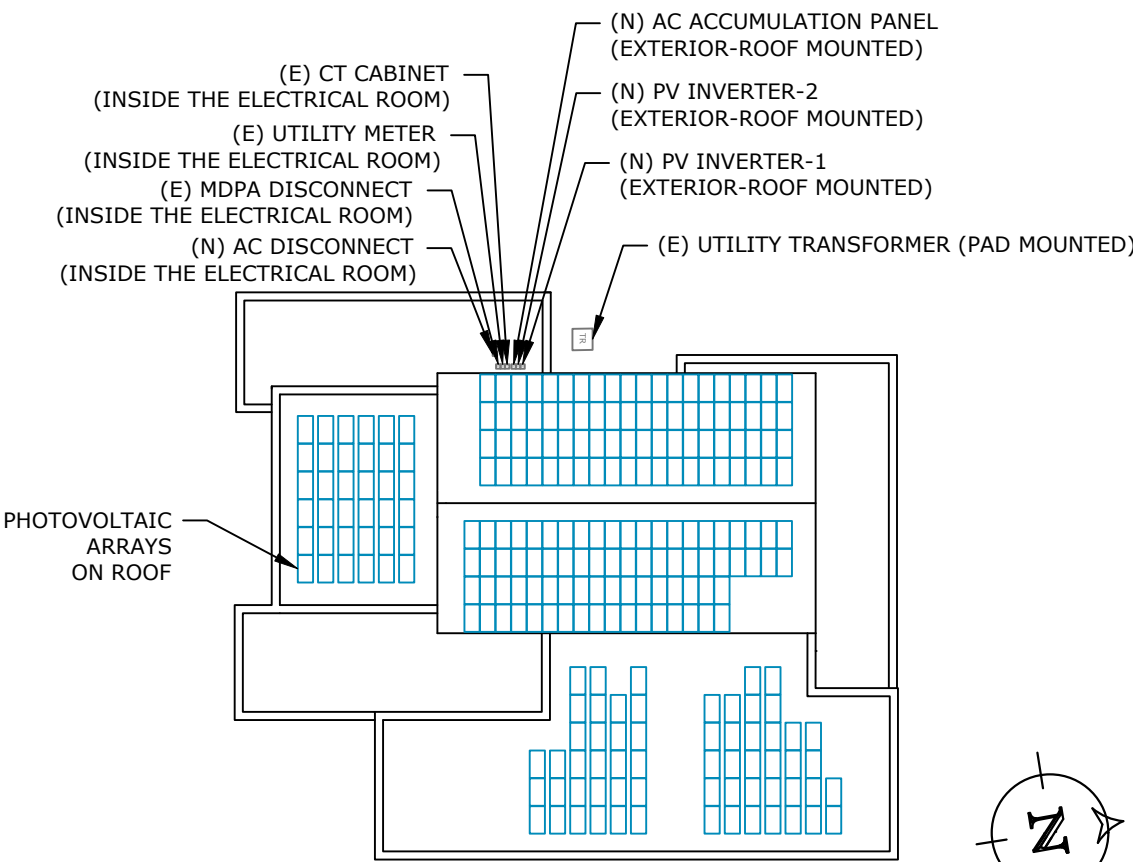

1605 CAMERON ST, ALEXANDRIA, VA 22314

LABEL LOCATION
SERVICE PANEL
PER CODE: NEC 705.10

NOTES

- 1.PLACARDS SHALL MEET THE REQUIREMENTS OF ARTICLES 690 AND 705, UNLESS OTHERWISE SPECIFIED PER LOCAL AHJ REQUIREMENTS.
- 2.PLACARDS SHALL MEET THE REQUIREMENTS OF SECTION 110.21(B) AS REQUIRED AND SHALL COMPLY WITH ANSI Z535.4-2011, PRODUCT SAFETY SIGNS AND LABELS.
- 3.PLACARDS SHALL BE PERMANENTLY AFFIXED TO THE EQUIPMENT OR WIRING METHOD.
- 4.PLACARDS SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED AND SHALL BE HANDWRITTEN.
- 5.PLACARDS SHALL NOT COVER EXISTING MANUFACTURER LABELS.

MODULE SPECIFICATION SHEET

Q.PEAK DUO BLK ML-G10+ SERIES

395 -415 Wp | 132 Cells
21.1% Maximum Module Efficiency

MODEL Q-PEAK DUO BLK ML-G10.a+
Q-PEAK DUO BLK ML-G10+



The ideal solution for:
Rooftop arrays on residential buildings



Breaking the 21% efficiency barrier
QANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 21.1%.



A reliable investment
Inclusive 25-year product warranty and 25-year linear performance warranty.



Enduring high performance
Long-term yield security with Anti LeTID Technology, Anti PID Technology and Hot-Spot Protect.



Extreme weather rating
High-tech aluminium alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).



Innovative all-weather technology
Optimal yields, whatever the weather with excellent low-light and temperature behaviour.



The most thorough testing programme in the industry
Qcells is the first solar module manufacturer to pass the most comprehensive quality programme in the industry. The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.


¹ See data sheet on rear for further information
² API test conditions according to IEC TS 62804-1209, method A - (500 V, 96h)



Q.PEAK DUO BLK ML-G10+ SERIES

■ Mechanical Specification

Format	74.0 in × 41.1 in × 1.26 in (including frame) (1879 mm × 1045 mm ± 12 mm)
Weight	48.5 lbs (22.0 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodised aluminium
Cell	6 × 22 monocrystalline QANTUM solar half cells
Junction box	2.08 × 3.98 in × 1.26 × 2.36 in ± 0.59 in (70 mm × 101 mm ± 15 mm, IP67, with bypass diodes)
Cable	4 mm ² Solar cable, (+) ≥ 72.04 in (1830 mm), (-) ≥ 72.04 in (1830 mm)
Connector	Substi MC4, IP68

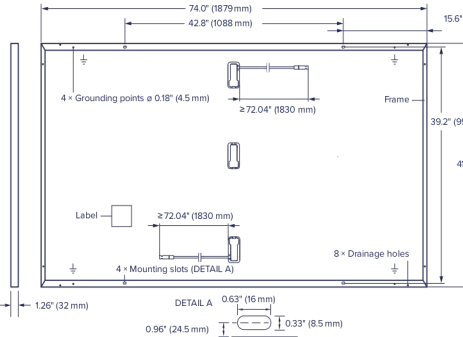


■ Electrical Characteristics

POWER CLASS		395	400	405	410	415	
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC (POWER TOLERANCE +5W/-0W)							
Minimum	Power at MPP ¹	P _{MPP} [W]	395	400	405	410	415
	Short Circuit Current ²	I _{SC} [A]	11.02	11.05	11.08	11.11	11.14
	Open Circuit Voltage ²	V _{OC} [V]	45.20	45.24	45.27	45.31	45.34
	Current at MPP	I _{MPP} [A]	10.48	10.54	10.60	10.65	10.71
	Voltage at MPP	V _{MPP} [V]	37.68	37.95	38.22	38.48	38.74
	Efficiency ³	η [%]	≥20.1	≥20.4	≥20.6	≥20.9	≥21.1


MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT⁴

Minimum	Power at MPP	P _{MPP} [W]	296.4	3001	303.9	307.6	311.4
	Short Circuit Current	I _{SC} [A]	8.88	8.91	8.93	8.95	8.98
	Open Circuit Voltage	V _{OC} [V]	42.63	42.66	42.69	42.73	42.76
	Current at MPP	I _{MPP} [A]	8.25	8.30	8.35	8.40	8.45
	Voltage at MPP	V _{MPP} [V]	35.93	36.16	36.39	36.61	36.84
	Measurement tolerances P _{MPP} ±3%; I _{SC} V _{OC} ±5% at STC; 1000 W/m ² , 25 ±2 °C, AM 1.5 according to IEC 60904-3 • 800 W/m ² , NMOT: spectrum AM 1.5						

Qcells PERFORMANCE WARRANTY

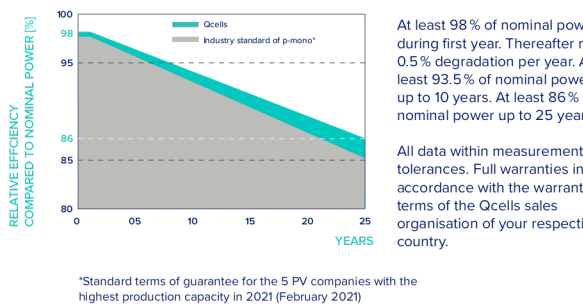

PERFORMANCE AT LOW IRRADIANCE

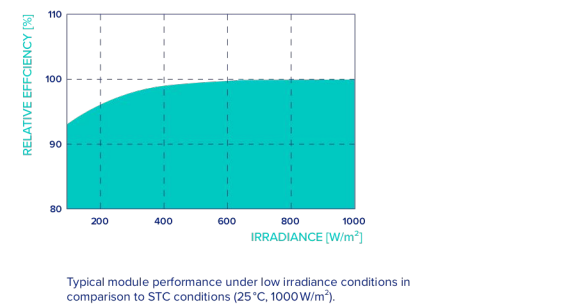


TEMPERATURE COEFFICIENTS							
Temperature Coefficient of I_{sc}	α	[%/K]	+0.04	Temperature Coefficient of V_{oc}	β	[%/K]	-0.27
Temperature Coefficient of P_{MPP}	γ	[%/K]	-0.34	Nominal Module Operating Temperature	NMOT	(°F)	109 ± 5.4 (43 ± 3 °C)

■ Properties for System Design

Maximum System Voltage	V _{max} [V]	1000 (IEC)/1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI/UL 61730	TYPE 2
Max. Design Load, Push/Pull ⁵	[lbs/ft ²]	75 (3600 Pa)/55 (2660 Pa)	Permitted Module Temperature on Continuous Duty	-40 °F up to +85 °F (-40 °C up to +85 °C)
Max. Test Load, Push/Pull ⁵	[lbs/ft ²]	113 (5400 Pa)/84 (4000 Pa)		

■ Qualifications and Certificates



¹ Contact your Qcells Sales Representative for details regarding the module's eligibility to be Buy American Act (BAA) compliant.

Qcells pursues minimizing paper output in consideration of the global environment.

New: Installation instructions must be followed. Contact our technical service for further information on approved installation of this product.

Hanwa Q-CELLS Service Inc. 400 Spectrum Center Drive, Suite 1600 Irvine, CA 92618, USA | TEL: +1 949 749 59 98 | Email: help@qcells.com | [WEB: www.qcells.com](http://www.qcells.com)



qcells

INVERTER SPECIFICATION SHEET

Three Phase Inverter with Synergy Technology

For the 208V Grid for North America

SE50KUS



12-20 YEAR WARRANTY

Powered by unique pre-commissioning process for rapid system installation

- Pre-commissioning feature for automated validation of system components and wiring during the site installation process and prior to grid connection
- Easy 2-person installation with lightweight, modular design (each inverter consists of 3 Synergy units and 1 Synergy Manager)
- Independent operation of each Synergy unit enables higher uptime and easy serviceability
- Built-in thermal sensors detect faulty wiring ensuring enhanced protection and safety
- Built-in arc fault protection and rapid shutdown
- Built-in PID mitigation for maximized system performance
- Monitored* and field-replaceable surge protection devices, to better withstand surges caused by lightning or other events
- Built-in module-level monitoring with Ethernet or cellular communication for full system visibility

*Applicable only for DC and AC SPDs

solaredge.com

solaredge

Three Phase Inverter with Synergy Technology

For the 208V Grid for North America

SE50KUS

MODEL NUMBER	SExxK-USx2xxxx	
APPLICABLE TO INVERTERS WITH PART NUMBER	SE50KUS	UNITS
OUTPUT		
Rated AC Active Output Power	50000	W
Maximum AC Apparent Output Power	50000	VA
AC Output Line Connections	2W + PE, 4W + PE	
Supported Grids	WYE: TN-C, TN-S, TN-C-S, TT, IT, Delta, IT	
AC Output Voltage Minimum-Nominal-Maximum ⁽¹⁾ (L-N)	105 ~ 120 ~ 132.5	Vac
AC Output Voltage Minimum-Nominal-Maximum ⁽¹⁾ (L-L)	183 ~ 208 ~ 229	Vac
AC Frequency Min-Nom-Max ⁽¹⁾	59.5 ~ 60 ~ 60.5	Hz
Maximum Continuous Output Current (per Phase, PF=1)	139.5	Aac
GFCI Threshold	1	A
Utility Monitoring, Islanding Protection, Configurable Power Factor, Country Configurable Thresholds	Yes	
Total Harmonic Distortion	≤ 3	%
Power Factor Range	±0.85 to 1	
INPUT		
Maximum DC Power (Module STC) Inverter / Synergy Unit	87500 / 23165	W
Transformer-less, Ungrounded	Yes	
Maximum Input Voltage DC+ to DC-	600	Vdc
Operating Voltage Range	370 ~ 600	Vdc
Maximum Input Current	5 ± 46.5	Aac
Reverse-Polarity Protection	Yes	
Ground-Fault Isolation Detection	10%CI sensitivity per Synergy Unit ⁽²⁾	
CEC Weighted Efficiency	97	%
Nighttime Power Consumption	< 12	W
ADDITIONAL FEATURES		
Supported Communication Interfaces ⁽³⁾	2 × RS485, Ethernet, Wi-Fi (optional), Cellular (optional)	
Smart Energy Management	Export Limitation	
Inverter Commissioning	With the SetApp mobile application using built-in Wi-Fi access point for local connection	
Arc-Fault Protection	Built-in, User Configurable (According to UL1699B)	
Photovoltaic Rapid Shutdown System	NEC 2014 ~ 2023, built-in	
PID Rectifier	Nighttime built-in	
RS485 Surge Protection (ports 1+2)	Type II, field replaceable, integrated	
AC, DC Surge Protection	Type II, field replaceable, integrated	
DC Fuses (Single Pole)	25A, integrated	
Pre-Commissioning	Built-in ⁽⁴⁾	
VAR at Night ⁽⁵⁾	Yes	
DC SAFETY SWITCH		
DC Disconnect	Built-in	
STANDARD COMPLIANCE		
Safety	UL1699B, UL1741, UL1741 SA, UL1741 SB, UL1998, CSA C22.2 #107.1, Canadian AFCI according to T.I.L. M-07	
Grid Connection Standards	IEEE 1547-2018, Rule 21, Rule 14 (H)	
Emissions	FCC part 15 class A	

(1) For other regional settings please contact SolarEdge support.
(2) Where permitted by local regulations.
(3) For specifications of the optional communication options, visit the [Communication product page](#) or the [Knowledge Center](#) to download the relevant product datasheet.
(4) Not available for 3-Phase, Single-throw.
(5) For details, see [SetApp Appstore Response at Night](#).

Three Phase Inverter with Synergy Technology

For the 208V Grid for North America

SE50KUS

MODEL NUMBER	SExxK-USx2xxxx	
APPLICABLE TO INVERTERS WITH PART NUMBER	SE50KUS	UNITS
INSTALLATION SPECIFICATIONS		
Number of Synergy Units per Inverter		
AC Max Conduit Size	2 1/2"	in
Max AWG Line / PE	4/0 / 100	
DC Max Conduit Size	1 x 2", 2 x 2"	in
DC Input Inverter / Synergy Unit	Multi-input (SExxK-USxxxxx24) Combined input (SExxK-USxxxxxW)	
Dimensions (H x W x D)	12 / 4 pairs: 6 ~ 12 AWG 3 pairs / 1 pair, Max 2 AWG, copper or aluminum Synergy Unit: 22 x 12.5 x 10.75 / 558 x 528 x 273 Synergy Manager: 14.17 x 22.4 x 11.6 / 360 x 560 x 295	in / mm
Weight	Synergy Unit: 70.4 / 32 Synergy Manager: 39.6 / 18	lb / kg
Operating Temperature Range	-40 to +140 / -40 to +60 ⁽¹⁾	T / °C
Cooling	Fan (user replaceable)	
Noise	< 47	dBA
Protection Rating	NEMA 3B	
Mounting	Brackets provided	

(1) For power de-rating information refer to the [Temperature Derating Technical Note for North America](#).

AMERICAN MICROGRID SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
(253)HANWHA Q CELLS Q-PEAK DUO BLK ML-G10.a+ (400Wp)

INVERTERS:
(2)SOLAREDGE TECHNOLOGIES SE50KUS (208V, 3PH)

OPTIMIZER/MLPE:
(129)SOLAREDGE P1101 POWER OPTIMIZER

WIND SPEED: 130MPH
SNOW LOAD: 61PSF
EXPOSURE CAT.: B

AHJ:VA-CITY OF ALEXANDRIA

UTILITY:DOMINION ENERGY

MIN. TEMP.: -11°C MAX. TEMP.: 35.1°C

SOLAR PV PROJECT:

DURANT RECREATION CENTER

1605 CAMERON ST,
ALEXANDRIA, VA 22314

38.807904, -77.056381
APN #10294550

PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE



ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

ELECTRICAL PLACARDS & SPEC SHEETS

DESIGNED BY/CHECKED BY:
ARUN S/RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED REV:B

DATE: 06/17/2025 E-06

Power Optimizer For North America

P1101

25
YEAR
WARRANTY

POWER OPTIMIZER

PV power optimization at the module level

The most cost-effective solution for commercial and large field installations

- Specifically designed to work with SolarEdge inverters
- High efficiency with module-level MPPT, for maximized system energy production and revenue, and fast project ROI
- Superior efficiency (99.5%)
- Balance of System cost reduction; 50% less cables, fuses, and combiner boxes; over 2x longer string lengths possible
- Fast installation with a single bolt
- Advanced maintenance with module-level monitoring
- Module-level voltage shutdown for installer and firefighter safety
- Meets NEC requirements for arc fault protection (AFC) and Photovoltaic Rapid Shutdown System (PVRSS)

solaredge.com

solar**edge**

Power Optimizer For North America

P1101

Power Optimizer Model (Typical Module Compatibility)	P1101 (for up to 2 x high power or bi-facial modules)	Units
INPUT		
Rated Input DC Power ⁽¹⁾	1000	W
Connection Method	Single input for series connected modules	
Absolute Maximum Input Voltage (Voc at lowest temperature)	125	Vdc
MPPT Operating Range	12.5 – 195	Vdc
Maximum Short Circuit Current (Isc)	14.1	Adc
Maximum Short Circuit Current per Input (IsC)	-	Adc
Maximum Efficiency	99.5	%
Weighted Efficiency	98.6	%
Overvoltage Category	II	
OUTPUT DURING OPERATION (POWER OPTIMIZER CONNECTED TO OPERATING SOLAREGE INVERTER)		
Maximum Output Current	18	Adc
Maximum Output Voltage	80	Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM SOLAREGE INVERTER OR SOLAREGE INVERTER OFF)		
Safety Output Voltage per Power Optimizer	1 ± 0.1	Vdc
STANDARD COMPLIANCE		
Photovoltaic Rapid Shutdown System	Compliant with NEC 2014, 2017, 2020	
EMC	FCC Part 15 Class A, IEC61000-6-2, IEC61000-6-3	
Safety	IEC62109-1 (Class II safety), UL1741, UL3741, CSA C22.2 24107.1	
Material	UL94 V-0, UV resistant	
RoHS	Yes	
INSTALLATION SPECIFICATIONS		
Compatible SolarEdge Inverters	All commercial three phase inverters	
Maximum Allowed System Voltage	1000	Vdc
Dimensions (W x L x H)	129 x 162 x 59 / 5.1 x 6.4 x 2.32	mm / in
Weight	106.4 / 2.34	g / lb
Input Connector	MC4 ⁽²⁾	
Input Wire Length Options	1	m / ft
	2	
	3	
Output Wire Type / Connector	Double insulated, MC4	
Output Wire Length	2.4 / 7.8	m / ft
Operating Temperature Range ⁽³⁾	-40 to +85 / -40 to +185	°C / °F
Protection Rating	IP68 / NEMA6P	
Relative Humidity	0 – 100	%

⁽¹⁾ Rated power of the module at STC will not exceed the Power Optimizer "Rated Input DC Power". Modules with up to +1% power tolerance are allowed.⁽²⁾ For other connector types please refer to the [Power Optimizer Input Connector Compatibility Technical Note](#).⁽³⁾ For ambient temperatures above +70°C / +187°F power derating is applied. Refer to [Power Optimizer Derating Application Note](#) for more details.

PV System Design Using a SolarEdge Inverter ⁽⁴⁾⁽⁵⁾	208V Grid SE10X	208V Grid SE7,3K ³	277/480V Grid SE30X	277/480V Grid SE40K ³	
Compatible Power Optimizers					
	PT101				
Minimum String Length	8	10	14	14	
PV Modules	15	19	27	27	
Maximum String Length	30	30	30	30	
PV Modules	60	60	60	60	
Maximum Continuous Power per String	7200	8820	15300	15300	W
Maximum Allowed Connected Power per String ⁽²⁾	1 string = 8400	1 string = 10020	1 string = 17550	2 strings or less = 17550	W
	2 strings or more = 9800	2 strings or more = 12020	2 strings or more = 20300	3 strings or more = 20300	
Yes					
Parallel Strings of Different Lengths or Orientations					
Maximum Difference in Number of Power Optimizers Allowed Between the Shortest and Longest String Connected to the Same Inverter Unit					
5 Power Optimizers					

⁽¹⁾ The same rules apply for Stringy units of equivalent power ratings, that are part of the modular Stringy Technology inverter.⁽²⁾ For each string, a Power Optimizer may be connected to a single PV module. If each Power Optimizer is connected to a single PV module or 2 it is the only Power Optimizer connected to a single PV module in the string.⁽³⁾ Design with three phase 208V inverters is limited. Use the [SolarEdge Designer](#) for verification.⁽⁴⁾ To connect more STC power per string, design your project using [SolarEdge Designer](#).

© SolarEdge Technologies, Ltd. All rights reserved. SOLAREGE, the SolarEdge logo, OPTIMIZED BY SOLAREGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: January 9, 2022 (SOL-00110) (N/A) Subject to change without notice.

RoHS
Intertek

AMP-TRAP® CP



Features/Benefits

- Fiberglass bodies for dimensional stability in harsh environments
- Catalog number stamped into terminal for permanent identification
- Crimp terminals for aluminum cable include oxide inhibitor
- Molded rubber boots or heat shrinkable tubing available for insulation and protection
- Current limiting device
- Permitted by code


Ratings

- Sizes #2 to 1000kcmil copper
- 4/0 to 1000kcmil aluminum
- 600VAC, 200kA I.R.

Approvals

- Ferraz Shawmut Certified
- UL Listed to File E305297

Catalog Numbering System

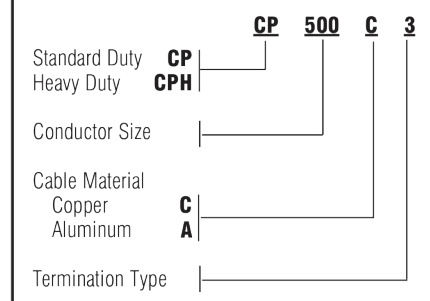

*Please consult factory for special terminations.

G 11

Gross Automation (877) 268-3700 • www.ferrazshawmutsales.com • sales@grossautomation.com

CABLE PROTECTORS/SPECIAL PURPOSE

CABLE PROTECTORS

Ferraz Shawmut CP Cable Protectors are special purpose limiters which are crimped or bolted to cables or terminals to clear and isolate faults quickly, increasing the reliability of service entrance and distribution runs. They are current limiting with a 200,000A interrupting rating, yet will carry low cable overloads which are handled by standard protective devices. Cable Protectors are rated in terms of cable size and material (Al or Cu). Heavier duty CPH Cable Protectors are available on special order. Heat shrinkable (HS) tubing can be specified for field installation. Refer to the Application Information Section for more information.

Description		Catalog # for Cable Type	
Type	Termination	Cable Size	Copper
1	Cable to Cable	2	CP2C1
		1/0	CP10C1
		2/0	CP20C1
		4/0	CP40C1
		250kcmil	CP250C1
		350kcmil	CP350C1
		400kcmil	CP400C1
		500kcmil	CP500C1
3	Cable to Offset to Bus	2	CP2C3
		1/0	CP10C3
		2/0	CP20C3
		4/0	CP40C3
		250kcmil	CP250C3
		350kcmil	CP350C3
		400kcmil	CP400C3
		500kcmil	CP500C3
5	Straight Bus to Offset Bus	4/0	CP40C5
		250kcmil	CP250C5
		350kcmil	CP350C5
		500kcmil	CP500C5
		600kcmil	CP600C5
		750kcmil	CP750C5
		1000kcmil	CP1000C5
		1000kcmil	CP1000C5
6	Male to Cable	4/0	CP40C6
		250kcmil	CP250C6
		350kcmil	CP350C6
		500kcmil	CP500C6
		600kcmil	CP600C6
		750kcmil	CP750C6
		1000kcmil	CP1000C6
		1000kcmil	CP1000C6
8	Male to Offset Bus	4/0	CP40C8
		250kcmil	CP250C8
		350kcmil	CP350C8
		500kcmil	CP500C8
		600kcmil	CP600C8
		750kcmil	CP750C8
		1000kcmil	CP1000C8
		1000kcmil	CP1000C8

G


IRONRIDGE

XR Rail® Family

Solar Is Not Always Sunny

Over their lifetime, solar panels experience countless extreme weather events. Not just the worst storms in years, but the worst storms in 40 years. High winds capable of ripping panels from a roof, and snowfalls weighing enough to buckle a panel frame.

XR Rails® are the structural backbone preventing these results. They resist uplift, protect against buckling and safely and efficiently transfer loads into the building structure. Their superior spanning capability requires fewer roof attachments, reducing the number of roof penetrations and the amount of installation time.

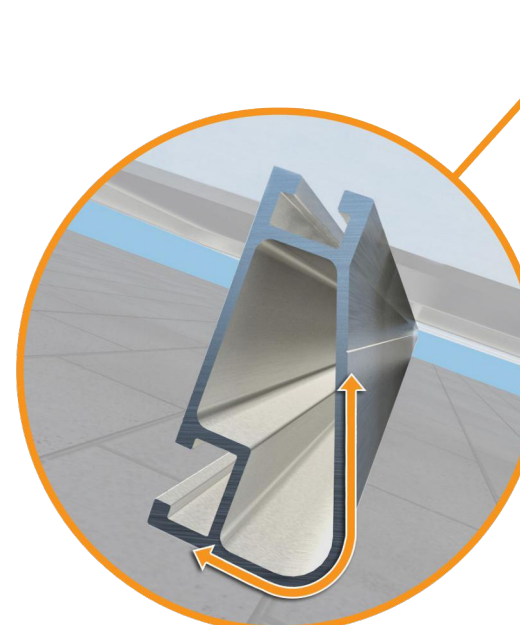


Force-Stabilizing Curve
Sloped roofs generate both vertical and lateral forces on mounting rails which can cause them to bend and twist. The curved shape of XR Rails® is specially designed to increase strength in both directions while resisting the twisting. This unique feature ensures greater security during extreme weather and a longer system lifetime.

Compatible with Flat & Pitched Roofs

XR Rails® are compatible with FlashFoot® and other pitched roof attachments.

Corrosion-Resistant Materials

All XR Rails® are made of 6060-series aluminum alloy, then protected with an anodized finish. Anodizing prevents surface and structural corrosion, while also providing a more attractive appearance.



XR Rail® Family

The XR Rail® Family offers the strength of a curved rail in three targeted sizes. Each size supports specific design loads, while minimizing material costs. Depending on your location, there is an XR Rail® to match.

XR10	XR100	XR1000
XR10 is a sleek, low-profile mounting rail, designed for regions with light or no snow. It achieves spans up to 6 feet, while maintaining light and economical.	XR100 is a residential and commercial mounting rail. It supports a range of wind and snow conditions, while also maximizing spans up to 10 feet.	XR1000 is a heavyweight among solar mounting rails. It's built to handle extreme climates and spans up to 12 feet for commercial applications.
<ul style="list-style-type: none">6' spanning capabilityModerate load capacityClear & black anodized finishInternal splices available	<ul style="list-style-type: none">10' spanning capabilityHeavy load capacityClear & black anodized finishInternal splices available	<ul style="list-style-type: none">12' spanning capabilityExtreme load capacityClear anodized finishInternal splices available

Rail Selection

The table below was prepared in compliance with applicable engineering codes and standards.* Values are based on the following criteria: ASCE 7-16, Gable Roof Flush Mount, Roof Zones 1 & 2a, Exposure B, Roof Slope of 8 to 20 degrees and Mean Building Height of 30 ft. Visit [IronRidge.com](#) for detailed certification letters.

Load		Rail Span					
Snow (PSF)	Wind (MPH)	4'	5' 4"	6'	8'	10'	12'
None	90	XR10		XR100		XR1000	
	120						
	140						
	160						
20	90						
	120						
	140						
	160						
30	90						
	160						
40	90						
	160						
80	160						
	160						
120	160						
	160						

*Table is meant to be a simplified span chart for conveying general rail capabilities. Use approved certification letters for actual design guidance.

© 2023 IronRidge, Inc. All rights reserved. Visit [www.ironridge.com](#) or call 1-800-227-8523 for more information. Version 1.22

IRONRIDGE

UFO® Family of Components

Simplified Grounding for Every Application

The UFO® family of components eliminates the need for separate grounding hardware by bonding solar modules directly to IronRidge® XR Rails®. All system types that feature the UFO® family—Flush Mount®, Tilt Mount® and Ground Mount®—are fully listed to the UL 2703 standard.

UFO® hardware forms secure electrical bonds with both the module and the rail, resulting in many parallel grounding paths throughout the system. This leads to safer and more reliable installations.

Only for installation and use with IronRidge products in accord with written instructions. See [IronRidge.com/UFO](#)




Stopper Sleeve
The Stopper Sleeve snaps onto the UFO®, converting it into a bonded end clamp.

Universal Fastening Object (UFO®)
The UFO® securely bonds solar modules to XR Rails®. It comes assembled and lubricated, and can fit a wide range of module heights.




BOSS® Splice
Bonded Structural Splice connects rails with built-in bonding teeth. No tools or hardware needed.



Grounding Lug
A single Grounding Lug connects an entire row of PV modules to the grounding conductor.

Bonded Attachments
The bonding bolt attaches and bonds the L-foot® to the rail. It is installed with the same socket as the rest of the system.

System Diagram

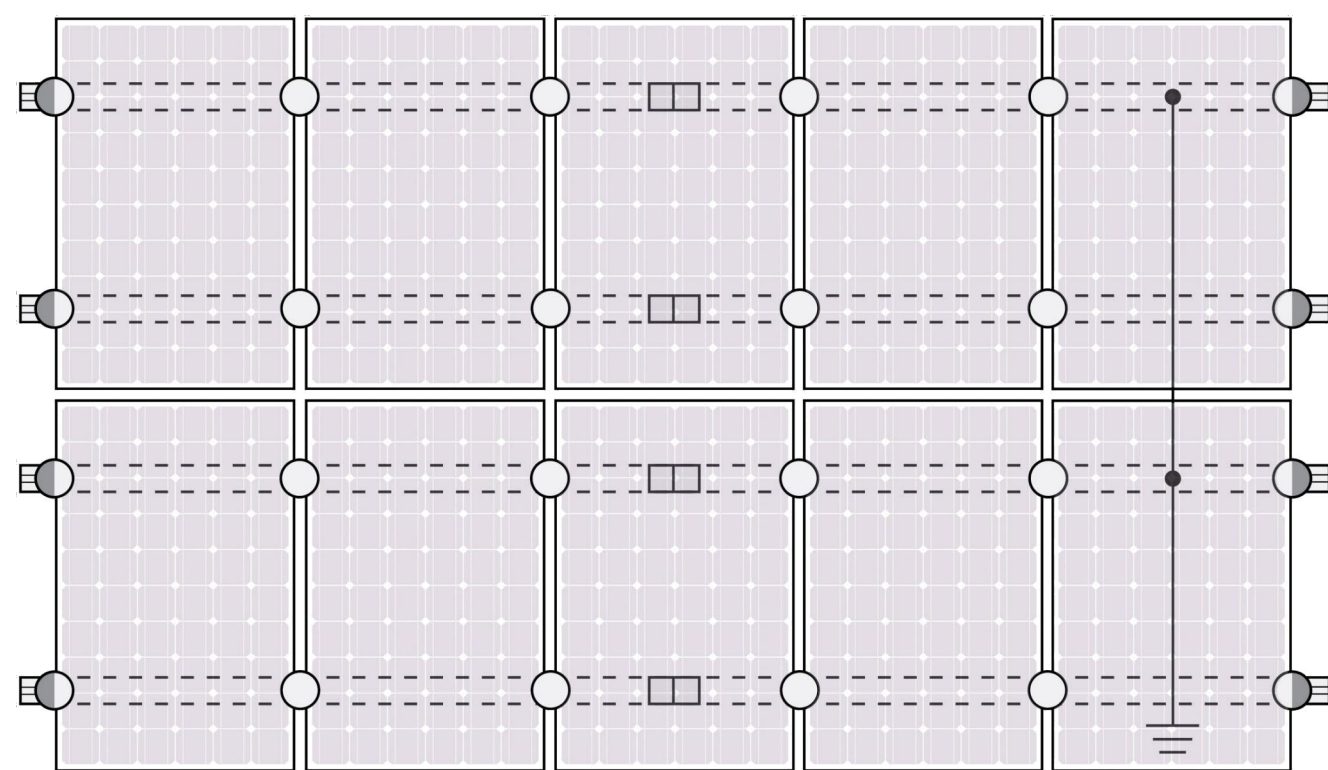

○ UFO ◐ Stopper Sleeve ● Grounding Lug □ BOSS® Splice ⊥ Ground Wire

✓ Approved Enphase microinverters can provide equipment grounding of IronRidge systems, eliminating the need for grounding lugs and field installed equipment ground conductors (EGC). A minimum of two microinverters mounted to the same rail and connected to the same Enphase cable is required. Refer to installation manuals for additional details.

UL Certification

The IronRidge® Flush Mount®, Tilt Mount®, and Ground Mount Systems have been listed to UL 2703 by Intertek Group plc.

UL 2703 is the standard for evaluating solar mounting systems. It ensures these devices will maintain strong electrical and mechanical connections over an extended period of time in extreme outdoor environments.

Go to [IronRidge.com/UFO](#)

Cross-System Compatibility			
Feature	Flush Mount	Tilt Mount	Ground Mount
XR Rails®	✓	✓	XR100 & XR1000
UFO®/Stopper	✓	✓	✓
BOSS® Splice	✓	✓	N/A
Grounding Lugs	1 per Row	1 per Row	1 per Array
Microinverters & Power Optimizers	Compatible with most MLPE manufacturers. Refer to system installation manual.		
Fire Rating	Class A	Class A	N/A
Modules	Tested or Evaluated with over 400 Framed Modules. Refer to installation manuals for a detailed list.		

© 2022 IronRidge, Inc. All rights reserved. Visit [www.ir-patents.com](#) for patent information. Version 1.23

AMERICAN MICROGRID SOLUTIONS

SYSTEM INFORMATION

SYSTEM SIZE (DC/AC):
101.20 kWp DC / 100.00 kW AC

MODULES:
**(253)HANWWHA Q CELLS Q-PEAK DUO
BLK ML-G10.a+ (400Wp)**

INVERTERS:
**(129)SOLAREEDGE TECHNOLOGIES
SE50KUS (208V, 3PH)**

OPTIMIZER/MLPE:
**(129)SOLAREEDGE P1101 POWER
OPTIMIZER**

WIND SPEED: **130MPH**
SNOW LOAD: **61PSF**
EXPOSURE CAT.: **B**

AHJ: **VA-CITY OF ALEXANDRIA**UTILITY: **DOMINION ENERGY**MIN. TEMP.: **-11°C** MAX. TEMP.: **35.1°C**

SOLAR PV PROJECT:

**DURANT RECREATION
CENTER**
**1605 CAMERON ST,
ALEXANDRIA, VA 22314**
38.807904, -77.056381
APN #10294550
PROJECT #AMG-DG-2024-499

REVISION HISTORY

REV	DATE	DESCRIPTION
A	03/24/2025	PERMIT PLAN
B	06/17/2025	SYSTEM SIZE UPDATE

ILLUMINE i

ILLUMINE INTERNATIONAL INC.
1320 ARROW POINT DR, STE 501, #163
CEDAR PARK, TX 78613

THIS DRAWING IS THE PROPERTY OF ILLUMINE INTERNATIONAL INC. THE INFORMATION CONTAINED IN THIS DRAWING SHALL NOT BE DISCLOSED TO OTHERS WITHOUT THE WRITTEN CONSENT OF ILLUMINE INTERNATIONAL INC.

SPEC SHEETS

DESIGNED BY/CHECKED BY:
ARUN S/ RAM BALAJI

PAPER SIZE: 24" X 36"

SCALE: AS NOTED REV: B

DATE: 06/17/2025 E-06.1

Existing



Proposed



New black PV's

Cinder Black

